



# PLUS TWP-XUT INSTALLATION GUIDE

IG\_PLUS\_TWP-XUT\_E02A

# PLUS TWP-XUT WIRELESS TRANSMITTER INSTALLATION GUIDE

## Table of contents

step  
**01**      **WGW420 PLUS WIRELESS GATEWAY CONFIGURATION**  
Pages 5 to 13

---

step  
**02**      **TWP-XUT PLUS WIRELESS TRANSMITTER CONFIGURATION**  
Pages 14 to 21

---

step  
**03**      **TWP-XUT TRANSMITTER TEMPERATURE INPUT CONFIGURATION**  
Pages 22 to 26

---

step  
**04**      **TWP-XUT TRANSMITTER DIGITAL OUTPUT CONFIGURATION**  
Pages 27 to 29

---

step  
**05**      **WGW420 GATEWAY ANALOG OUTPUTS CONFIGURATION**  
Pages 30 to 32

# PLUS TWP-XUT WIRELESS TRANSMITTER INSTALLATION GUIDE

## Table of contents

step <b>06</b>	<b>WRP001 PLUS WIRELESS REPEATER CONFIGURATION</b> Pages 33 to 40
-------------------	--

---

step <b>07</b>	<b>SITE SURVEY MODE</b> Pages 41 to 42
-------------------	---

---

step  
**01**

**WGW420 PLUS WIRELESS GATEWAY CONFIGURATION**

WG420 PLUS WIRELESS GATEWAY CONFIGURATION | step **01**

TEKON CONFIGURATOR SOFTWARE is only compatible with the Microsoft® Windows® Operating System.

**01** Connect the antenna to the *Gateway*.



**02** **Wiring**  
Connect the power supply and then the *RS485-USB* cable to the *Gateway*.



Wire Indication:  
Blue - GND; Brown - +24 VDC; Orange - Data+ (A); Black - GND; Yellow - Data - (B)

**03** Power ON the device.




step

**01**

WGW420 PLUS WIRELESS GATEWAY CONFIGURATION


**04**

Check device connection state by LED indication.

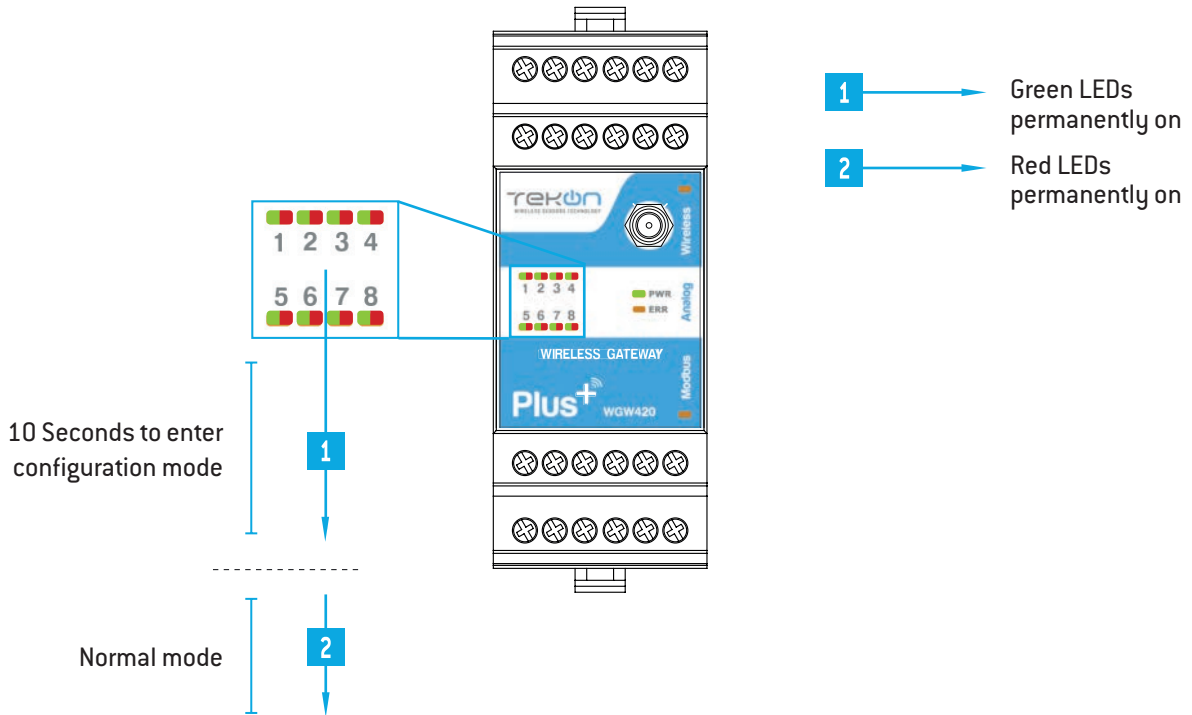

**05**

Open *Tekon Configurator Software*<sup>1</sup>

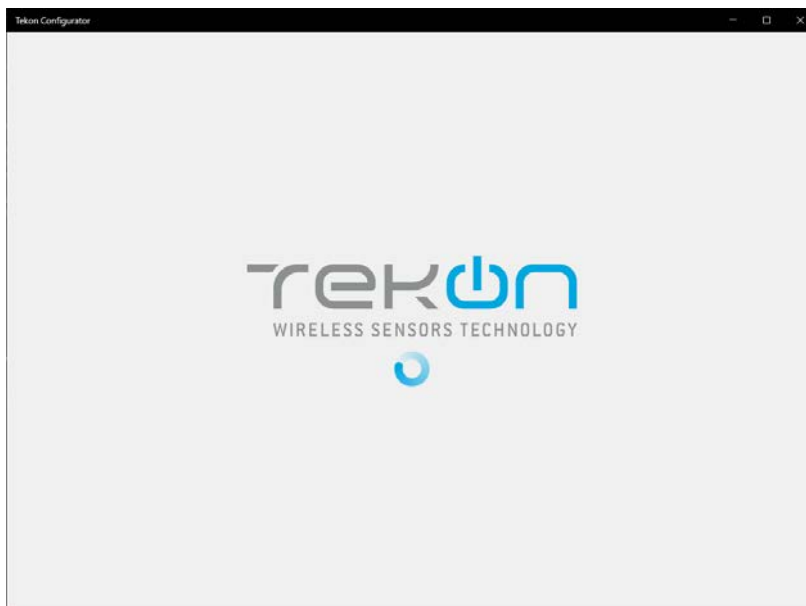


<sup>1</sup> Tekon Configurator software is free of charge and available at [www.tekonelectronics.com](http://www.tekonelectronics.com)

**06**


**Open the WGW420 PLUS Wireless Gateway device page.**

You can enter the device's page in the following ways:

**1st option:** Click on **"SMART TRANSMITTERS"** in the left menu and then click on the WGW420 device.

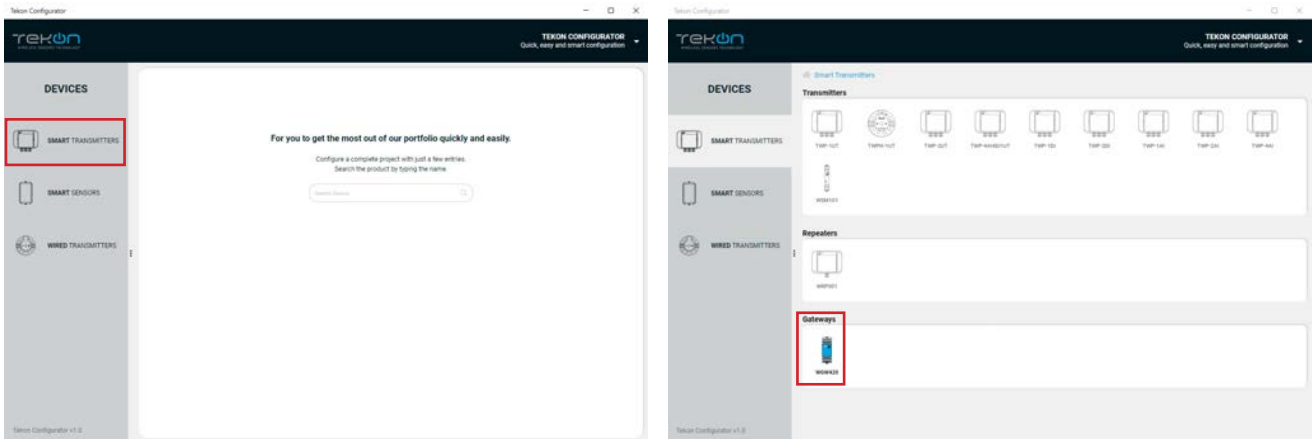

**2nd option:** Type the name of the device in the **"Search Device"** field on the home page and select.

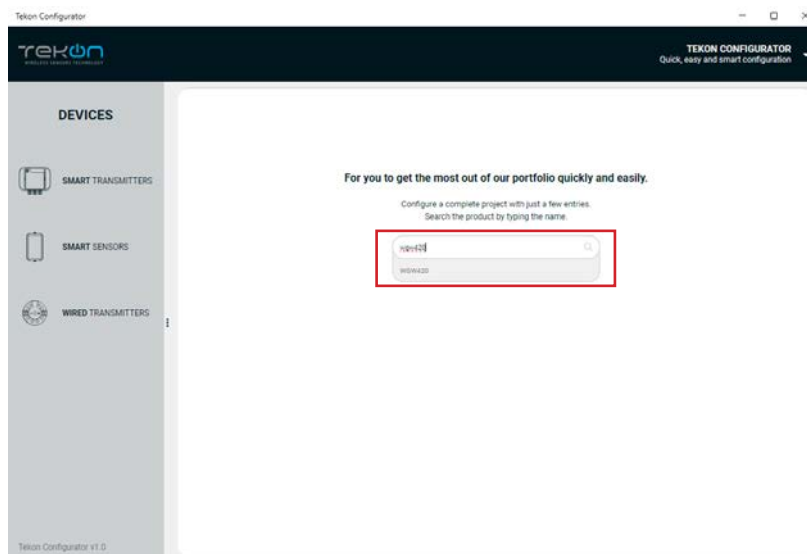


step

**01**

WG420 PLUS WIRELESS GATEWAY CONFIGURATION

**07**

Load the “Port COM” corresponding to the WG420 Wireless Gateway.

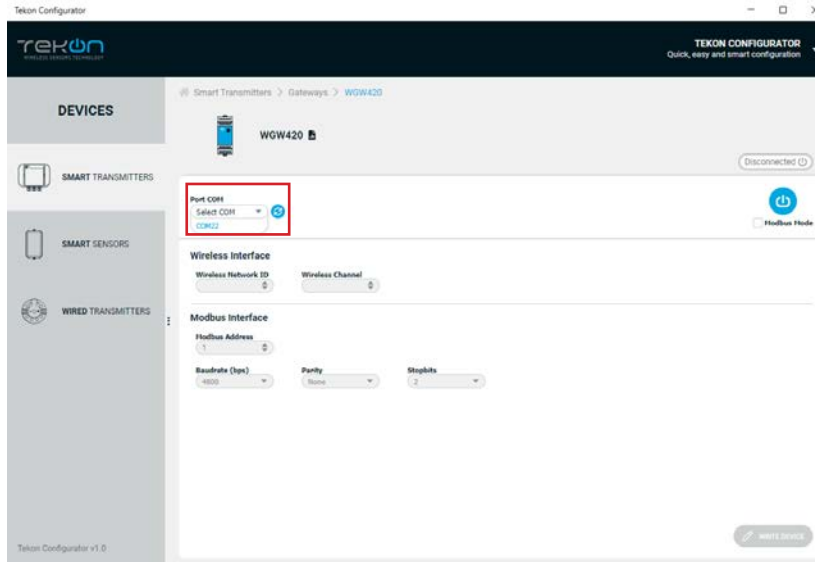


**NOTE:**

If the USB cable has already been connected before opening the device page, “Port COM” will appear in the list, otherwise you need to click on the “🔌” button.

**08**

Select corresponding *Port name*<sup>2</sup>.

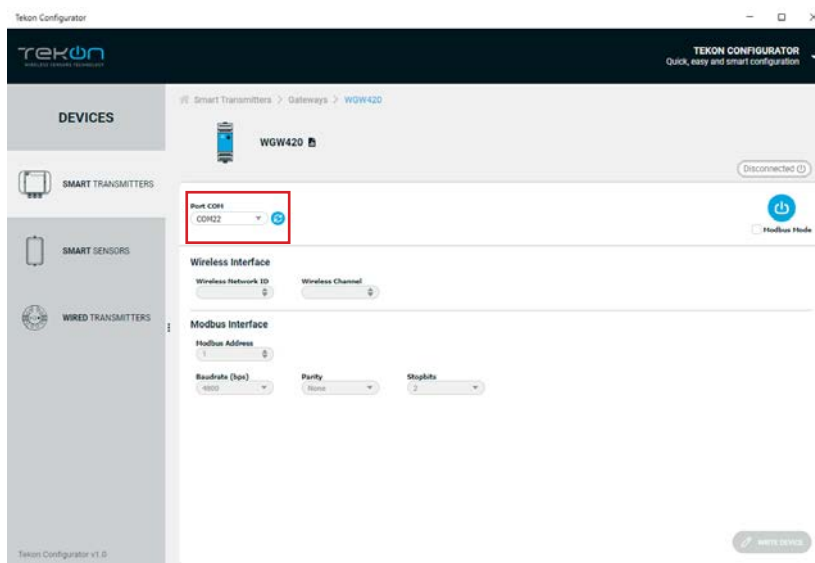


<sup>2</sup> You can check device's serial port name in “Device Manager” on Microsoft® Windows® operating system.




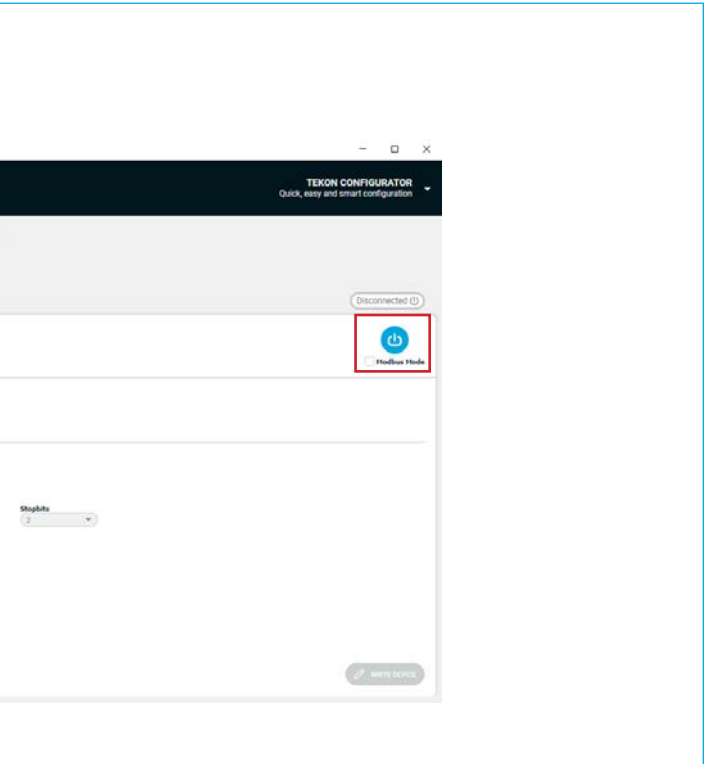
step  
**01**  
WG420 PLUS WIRELESS GATEWAY CONFIGURATION

**09** Perform a power cycle on the *Gateway*.



**NOTE:** After power up, you have 10 seconds to enter configuration mode by clicking on Connect button [  ] (while green LEDs are permanently on). In this mode, you can manage device parameters: *Modbus Address*, *Modbus Baudrate*, *Modbus Parity*, *Wireless Network ID* and *Wireless Channel*.

**10** Click on *Connect* (  ) button.




step  
**01**

WGW420 PLUS WIRELESS GATEWAY CONFIGURATION

**11**

The software will connect to the device.

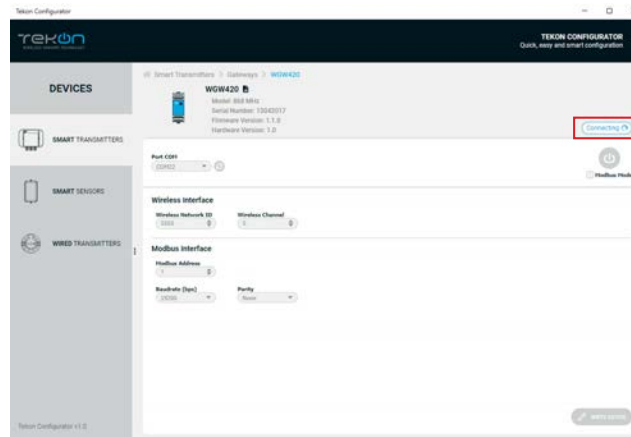

**NOTE:**


If the software is unable to connect to the device, the **Connection Failed** status is displayed. If it hasn't connected, go back to the previous steps and check the port COM.

**12**

When the software connects to the device, the "Connected" message will be displayed.



You can also verify configuration mode activation by checking LEDs on the gateway.

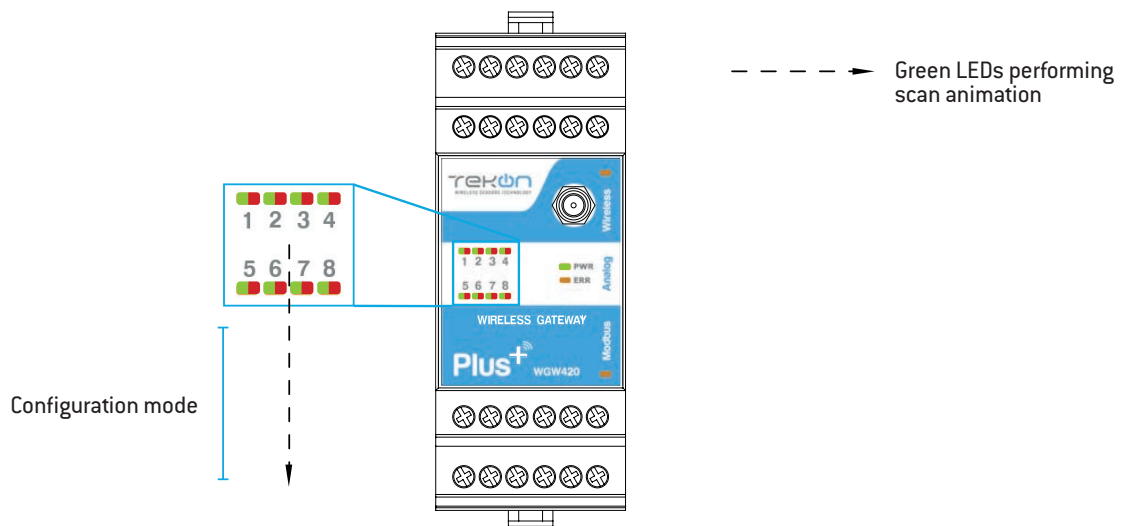


**NOTE:**

When the 10-second time frame to enter configuration mode is exceeded, the LEDs will turn permanently red and the gateway will enter normal operation mode. To get back in configuration mode, you need to perform a power cycle - step 8.

**13**

Take note of device configuration data available, namely: *Modbus Address*, *Modbus Baudrate*, *Modbus Parity*, *Wireless Network ID* and *Wireless Channel*.

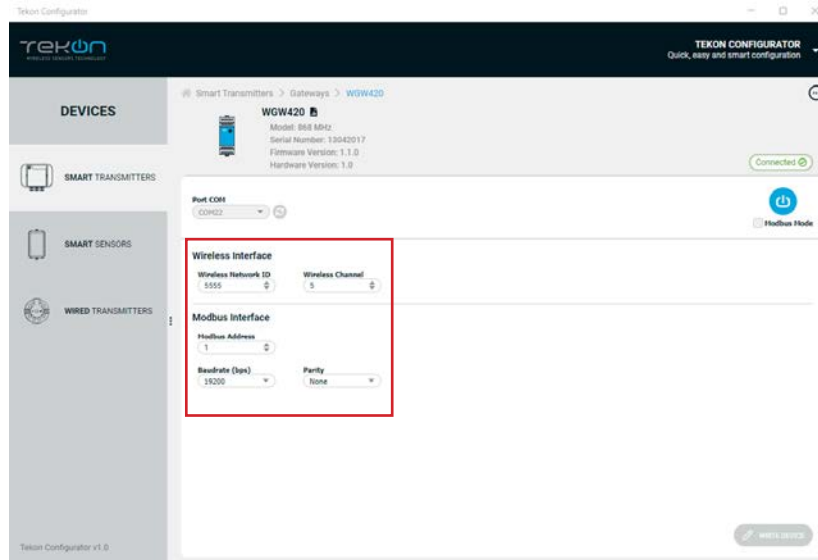



**NOTE:**

The wireless network connection between devices is ensured by setting the same *Wireless Network ID* and *Wireless Channel* parameters.

You can change the editable parameters. To save your changes, click on WRITE DEVICE. If the changes have been written to the device, the symbol [✓] will appear. If not, the symbol [✗] will appear: try again and check that the device is connected correctly.

**14**

Click on the *Disconnect* button.

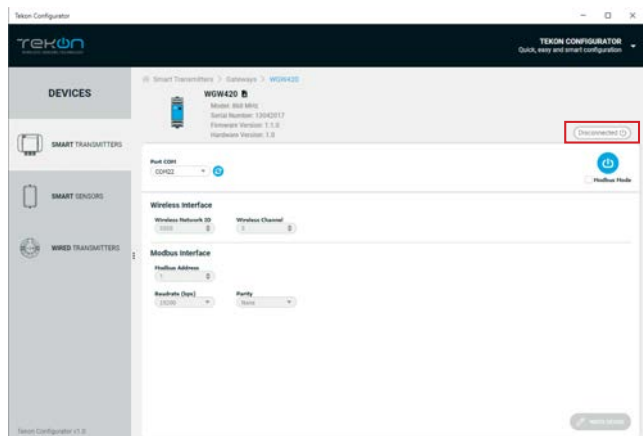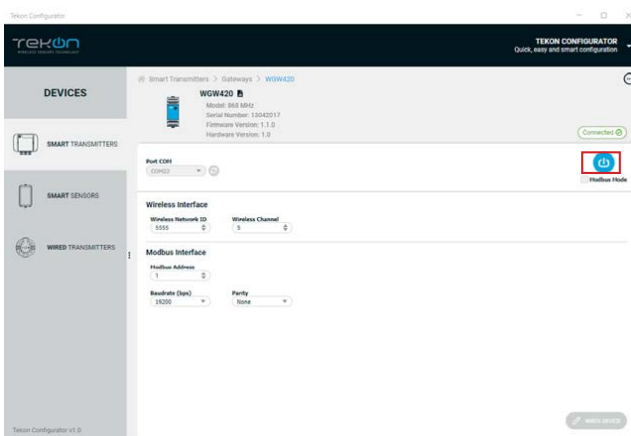

The “Connected” status changes to “*Disconnected*”.

step


**01**

WG420 PLUS WIRELESS GATEWAY CONFIGURATION

**15**


**Modbus Communication**

Select modbus mode in the checkbox below the Connect button.

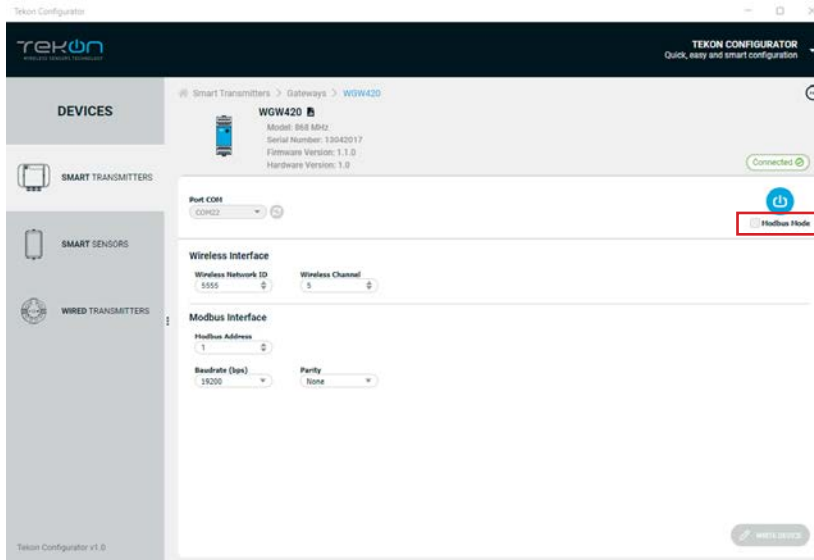

**16**


Ensure that *Port name*, *Baudrate*, *Parity* and *Modbus Address* fields are the same as those obtained in configuration mode.

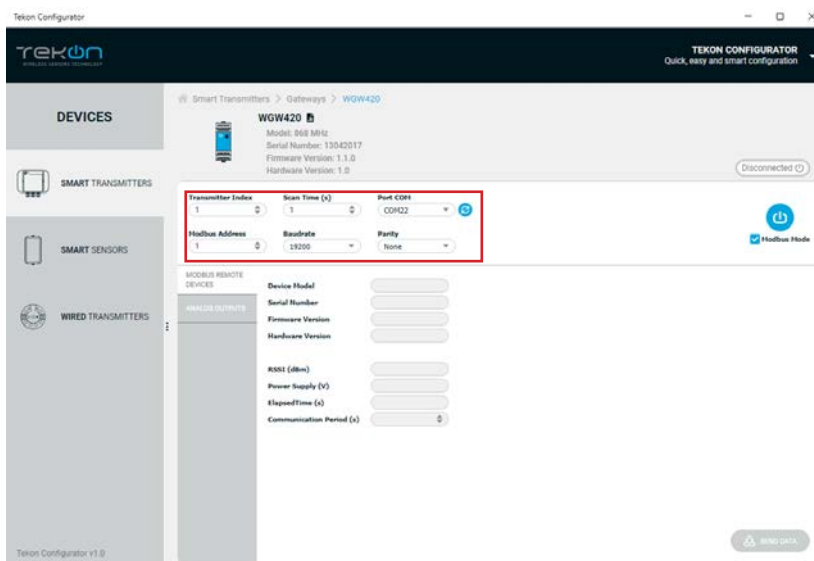


step **01**  
WG420 PLUS WIRELESS GATEWAY CONFIGURATION

**17**

Click on connect and check that the status is *“Connected”*.

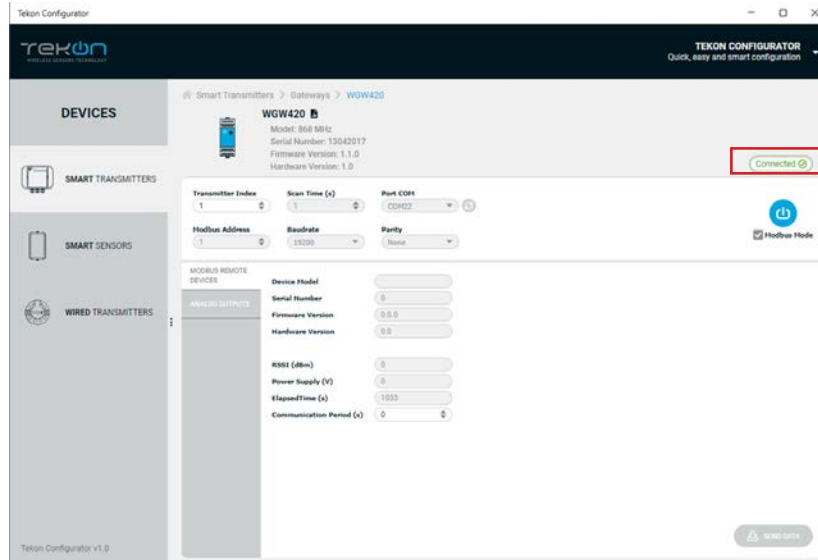

**16**

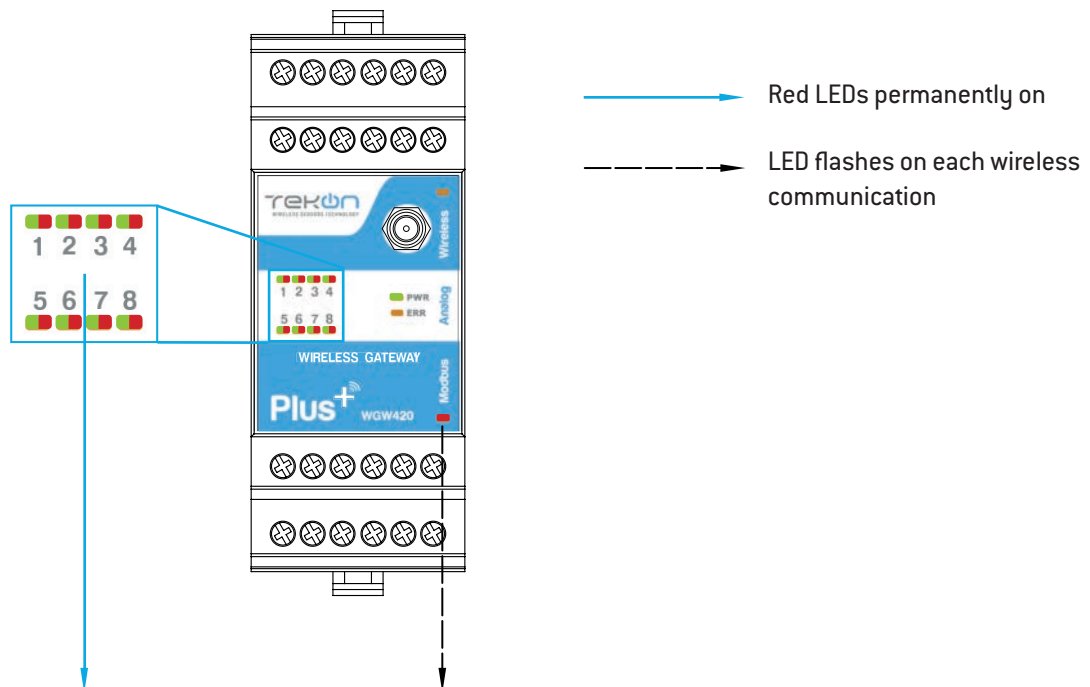

**NOTE:**

See WG420 Datasheet to access LED indication information - page 4.

step  
**02**

**TWP-XUT PLUS WIRELESS TRANSMITTER CONFIGURATION**

TWP-XUT PLUS WIRELESS TRANSMITTER CONFIGURATION **step 02**

**01** Loosen the 4 screws of the case and open it.

[Example image]



**02** Connect a micro USB cable to the computer and then to *TWP-1UT PLUS Wireless Transmitter*.

[Example image]



**03** Open *Tekon Configurator Software*

step  
**02**


**TWP-XUT PLUS WIRELESS TRANSMITTER CONFIGURATION**

**04**


**Open the TWP-1UT PLUS Wireless Transmitter device page.**

You can enter the device's page in the following ways:

**1st option:** Click on **"SMART TRANSMITTERS"** in the left menu and then click on the TWP-1UT.

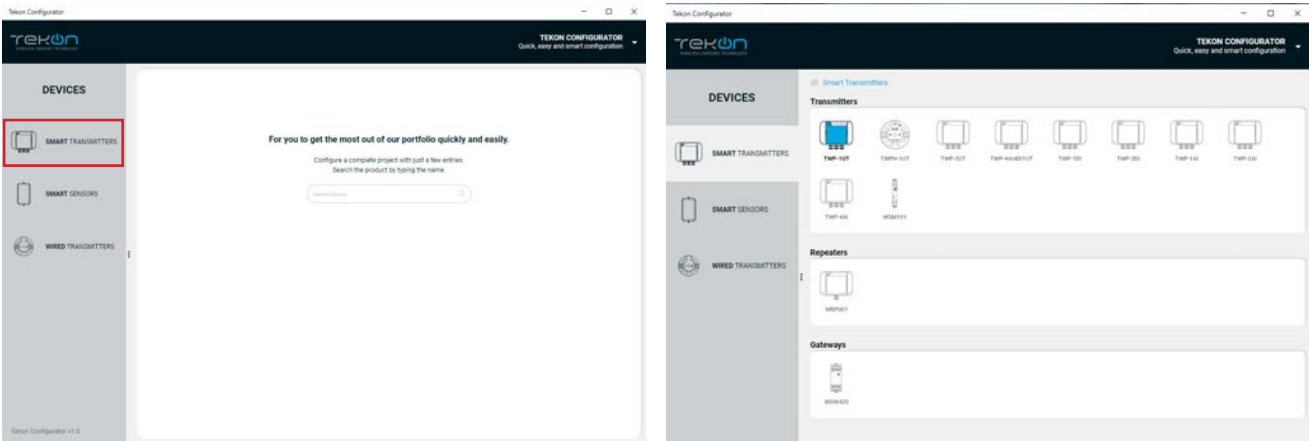


**2nd option:** Type the name of the device in the **"Search Device"** field on the home page and select.

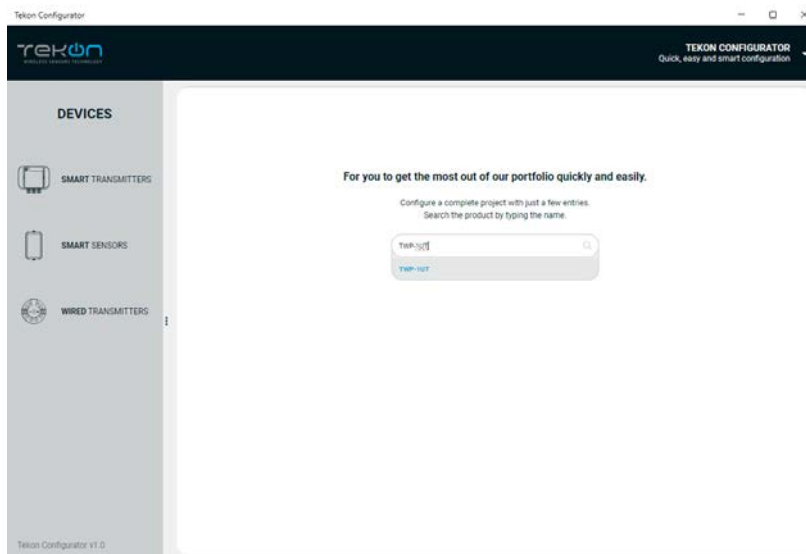




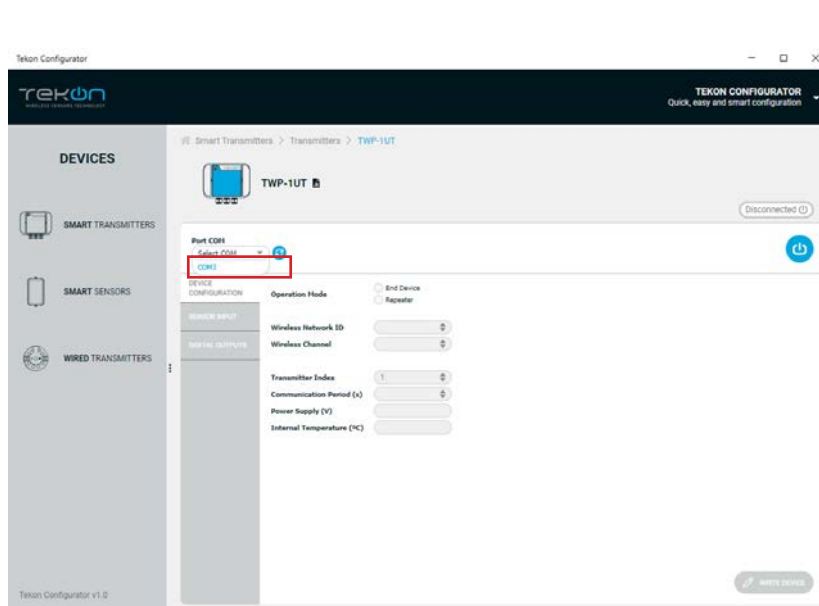
TWP-XUT PLUS WIRELESS TRANSMITTER CONFIGURATION

**05** Load the “Port COM” corresponding to the TWP-1UT PLUS Wireless Transmitter.

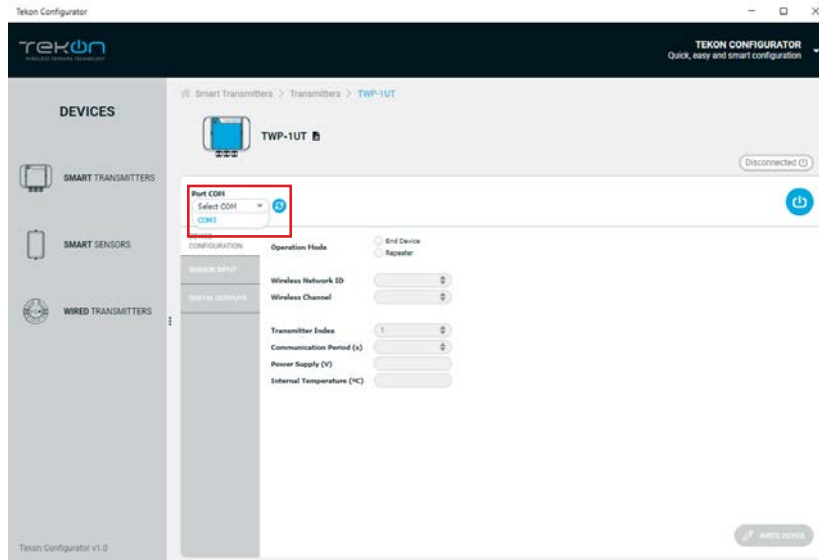

**NOTE:** If the USB cable has already been connected before opening the device page, “Port COM” will appear in the list, otherwise click the button 

**06** Select corresponding *Port Com*<sup>2</sup>.



<sup>2</sup> You can check device’s serial port name in “Device Manager” on Microsoft® Windows® operating system.



step

**02**

TWP-XUT PLUS WIRELESS TRANSMITTER CONFIGURATION

**07**


Click on the “Connect” button (  ) to enter *Configuration Mode*.

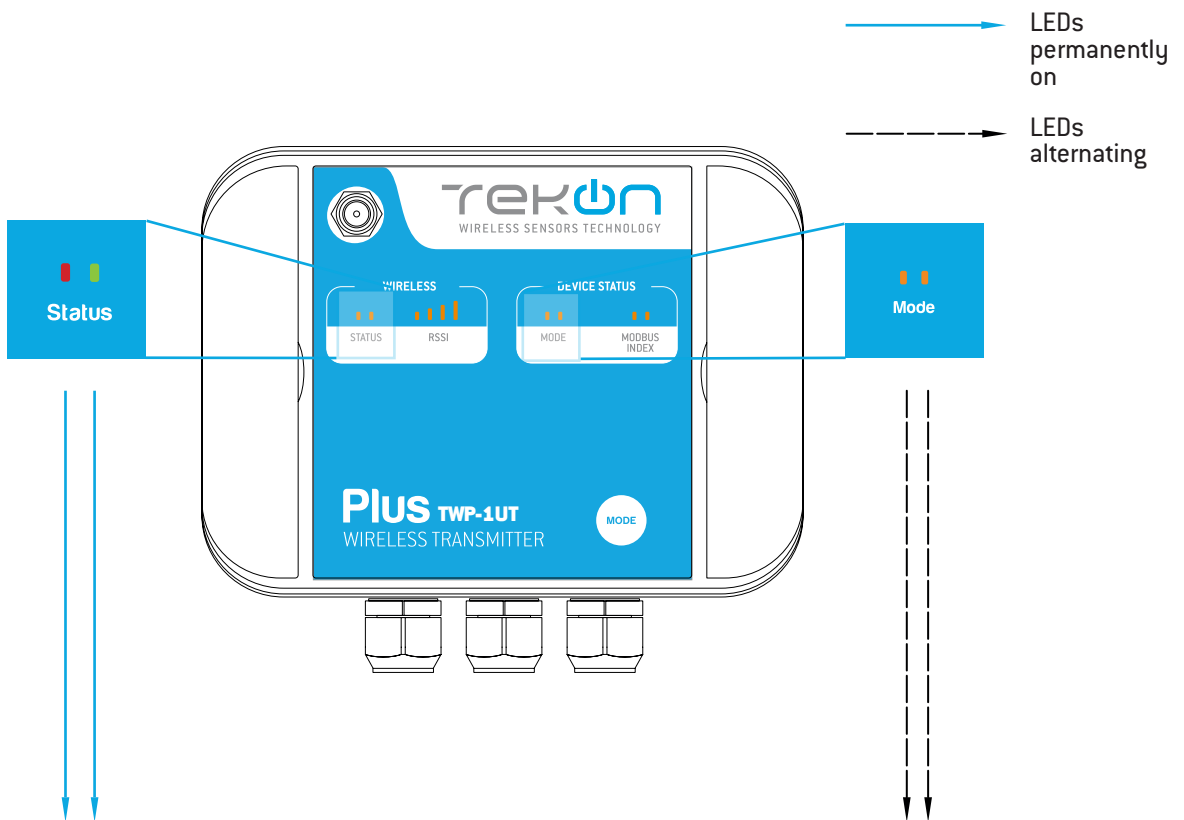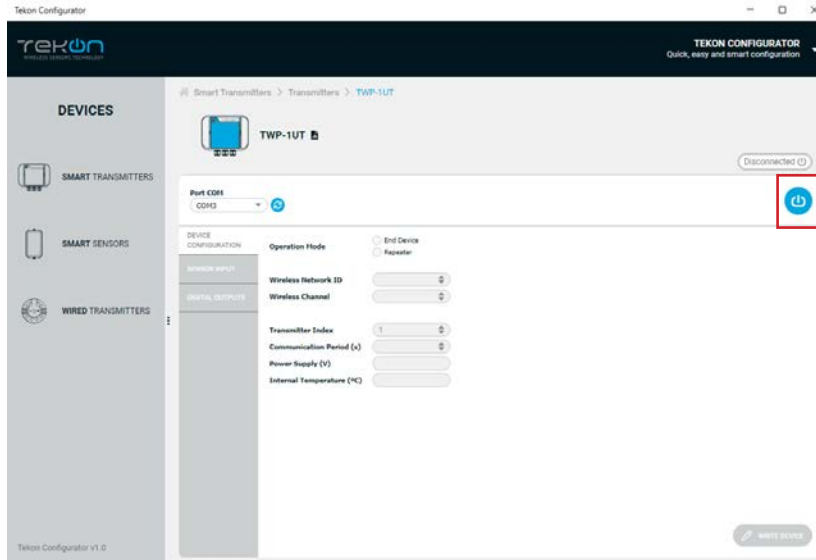


step  
**02**


TWP-XUT PLUS WIRELESS TRANSMITTER CONFIGURATION

**08** The software will connect to the device.

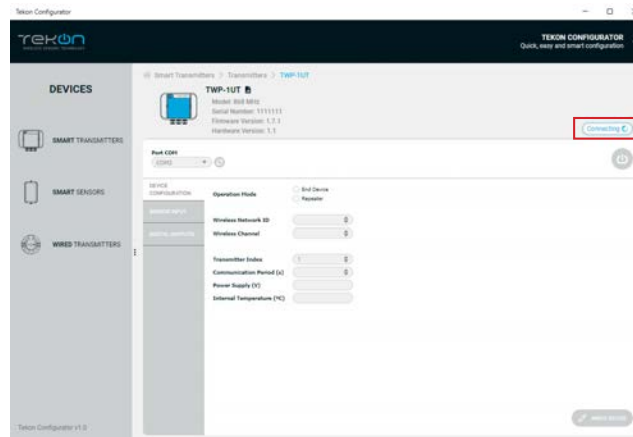

**NOTE:** If the software is unable to connect to the device, the  Unexpected Error status is displayed. If it hasn't connected, go back to the previous steps and check the port COM.

**09** When the software connects to the device, the "Connected" message will be displayed.

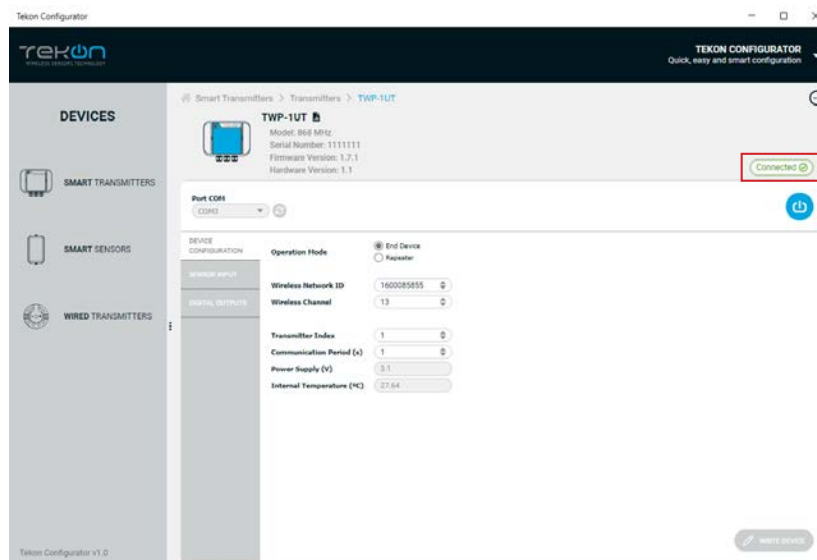

step

**02**


TWP-XUT PLUS WIRELESS TRANSMITTER CONFIGURATION

10

Configure *Wireless Network ID* and *Wireless Channel* previously obtained from *Gateway*.

The wireless connection between both devices is ensured by setting the same *Wireless Network ID* and *Wireless Channel* parameters. Gateway Modbus Index will define the modbus registers window used to store information sent by the transmitter. Each transmitter should have a different *Gateway Modbus Index* in order to avoid information override.

Click on *Write Device* button to update *Transmitter* settings.

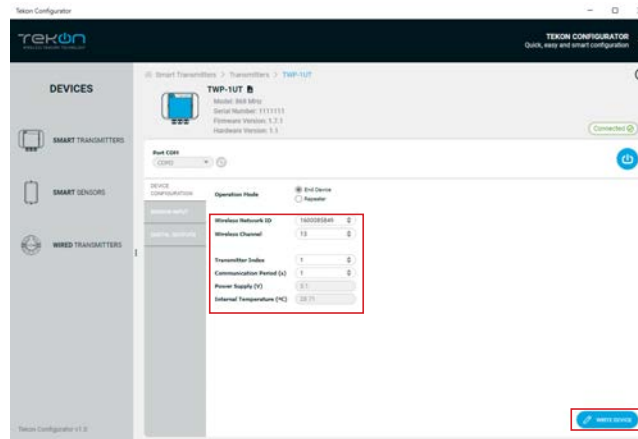

On this page you can configure the transmitter's *communication period*, i.e. the time interval between measurements and communication of the values to the gateway. In addition, you can configure the *reconnection period* which is only triggered when communication between the gateway and the transmitter fails. When communication fails, the transmitter will try to connect to the gateway using the following logic:

- 5 attempts with the communication period set;
- N attempts with the reconnection period until communication is successful.


The default reconnection period is 30 minutes. Please note that short reconnection periods (< 30 minutes) will impact the transmitter's autonomy if communication takes a long time to be re-established.



**NOTE:**

The "WRITE DEVICE" button will only be active when there is a change to one of the editable fields, if there is no change it will be deactivated.


While the settings are being written, the following icon will be displayed next to the "WRITE DEVICE" button (🔄)

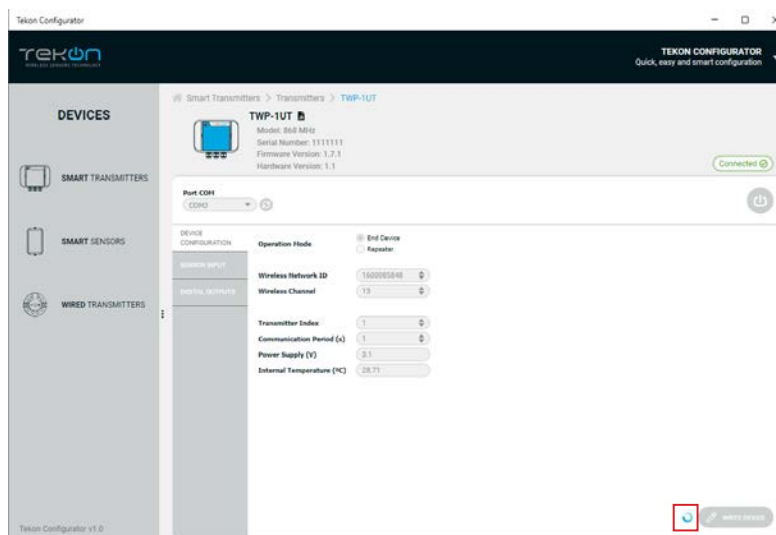

TWP-XUT PLUS WIRELESS TRANSMITTER CONFIGURATION **step 02**

If the changes to the device have been written, the following symbol will appear ( ✓ )



If not, the following symbol will appear ( ✗ ), try again and check that the device is connected correctly.

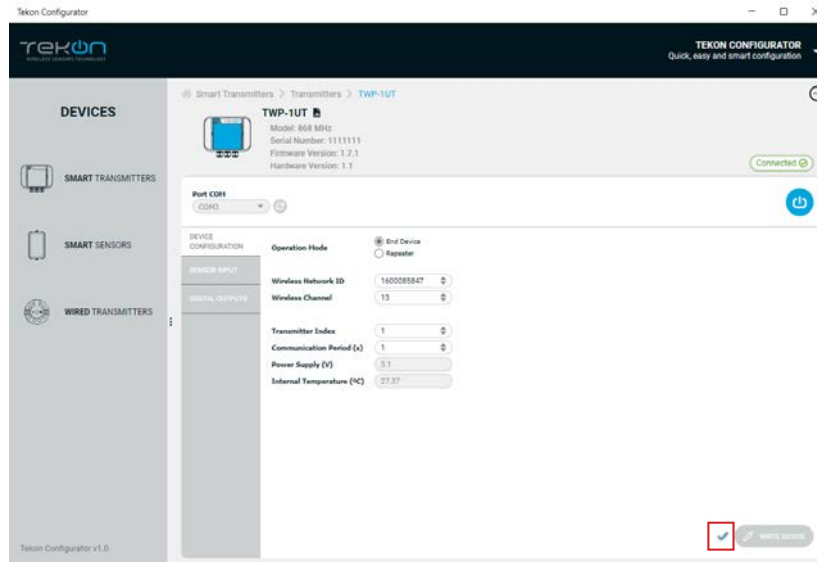

**11**

Click on the button ( ⏻ ) to exit *configuration mode* and return the device to normal operating mode.

After clicking on *Disconnect* button, the device will permanently attempt to connect to a wireless network. If there is no communication, the Status LED flashes slowly and the Mode LED flashes quickly. When there's a successful connection directly to a wireless network, both status LEDs alternate quickly - during 1 minute if the transmitter is operating as end device or permanently if operating as repeater.

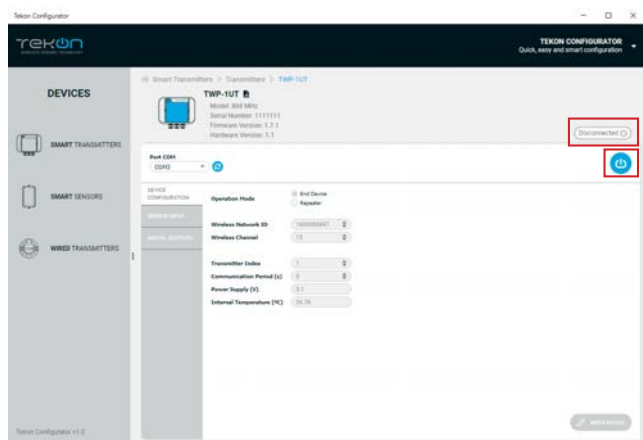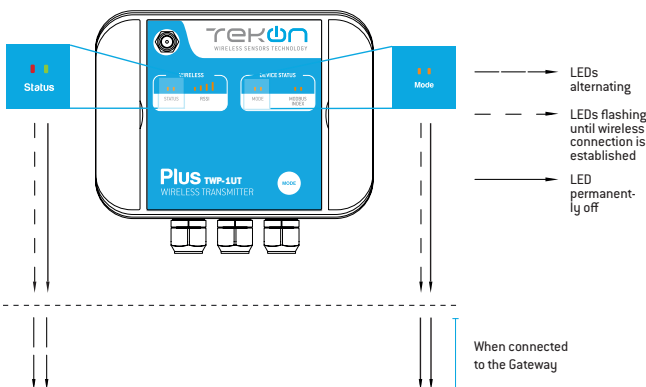

**NOTE:** Make sure that the devices are at a distance of at least 3 meters or remove the antenna from the gateway (in case both devices are near each other).

step  
**03**

**TWP-XUT TRANSMITTER TEMPERATURE INPUT CONFIGURATION**

TWP-XUT TRANSMITTER TEMPERATURE INPUT CONFIGURATION



**NOTE:**


By default, temperature inputs are configured as PT100 3W. Each temperature input can be configured independently, as PT100 or Thermocouple.

**01**

To enter in *Configuration Mode* follow steps 01 to 07 of TWP-XUT PLUS Wireless *Transmitter* Configuration.


**02**

In the Tekon Configurator Software, click on *“Sensor Input”* to open the sensor settings.

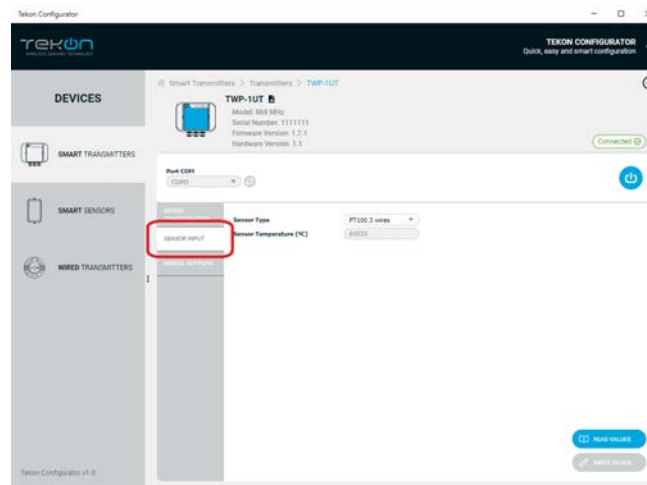

**03**

As an example, select *PT100 wires* option on Sensor Type and click *Write Device*.

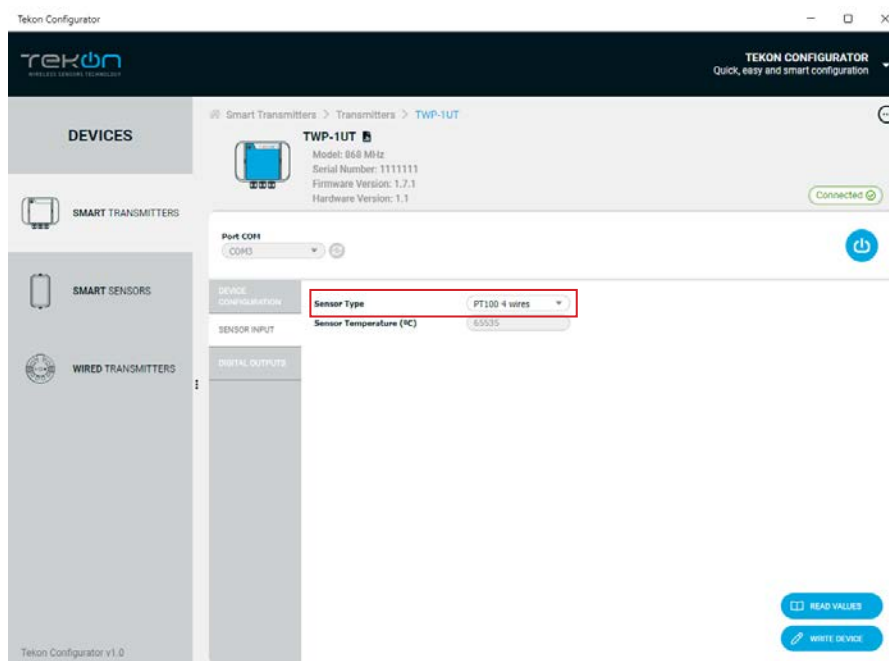

If you are configuring *PLUS TWP-2UT*, reproduce configuration steps to the second temperature input.


step


# 03

## TWP-XUT TRANSMITTER TEMPERATURE INPUT CONFIGURATION

### 04

Wait for the software to write the new setting to the device. Wait for the status  to change to .

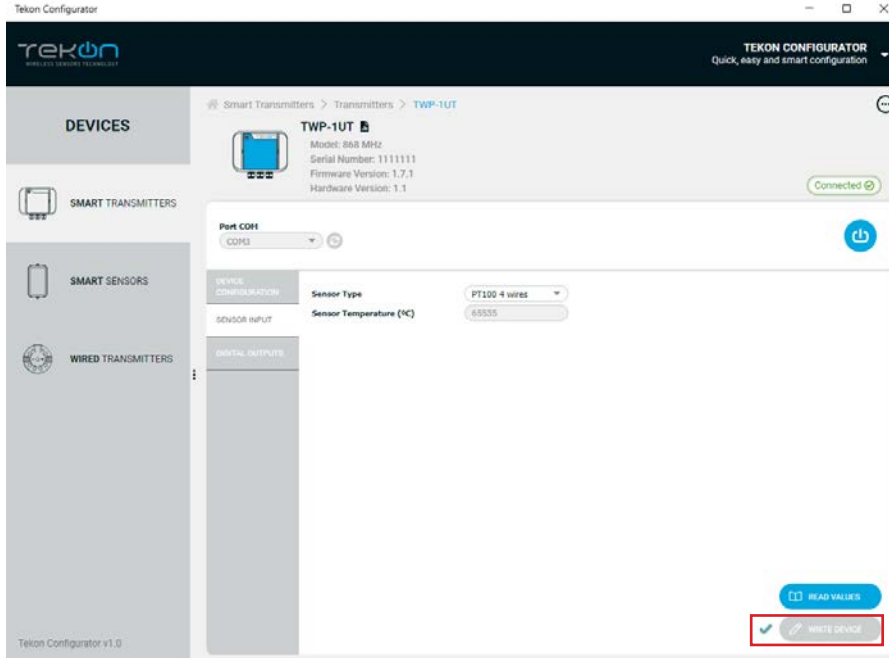


If the writing of the device is not completed, you will see . Make sure that all the steps have been carried out correctly.

### 05

#### Wiring

Wire the device according to the diagram below.

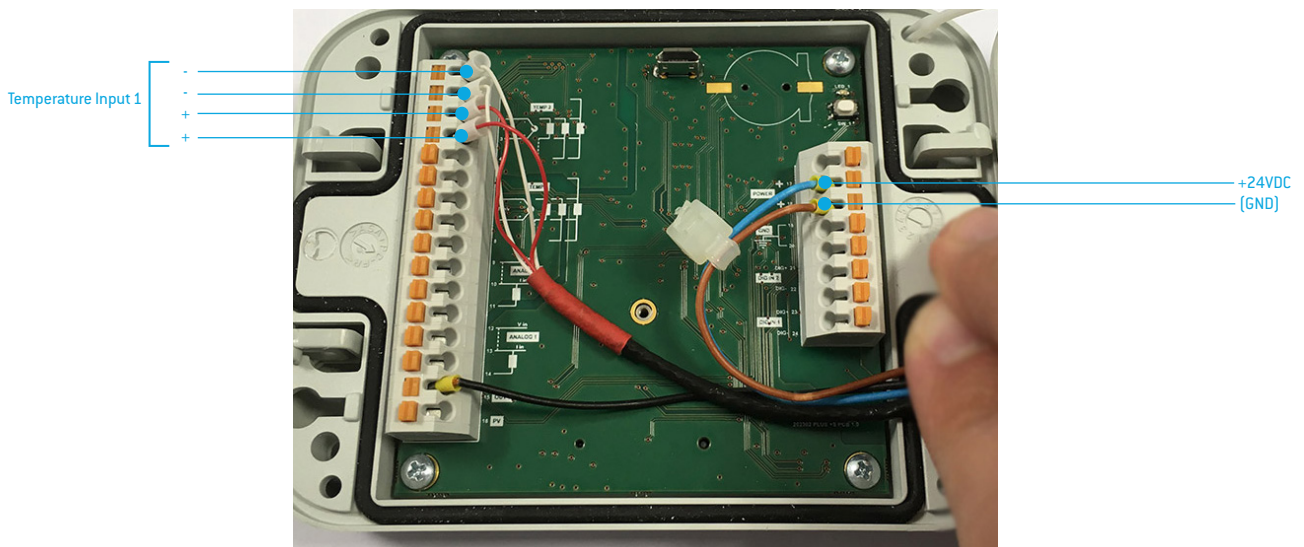







TWP-XUT TRANSMITTER TEMPERATURE INPUT CONFIGURATION


**06**

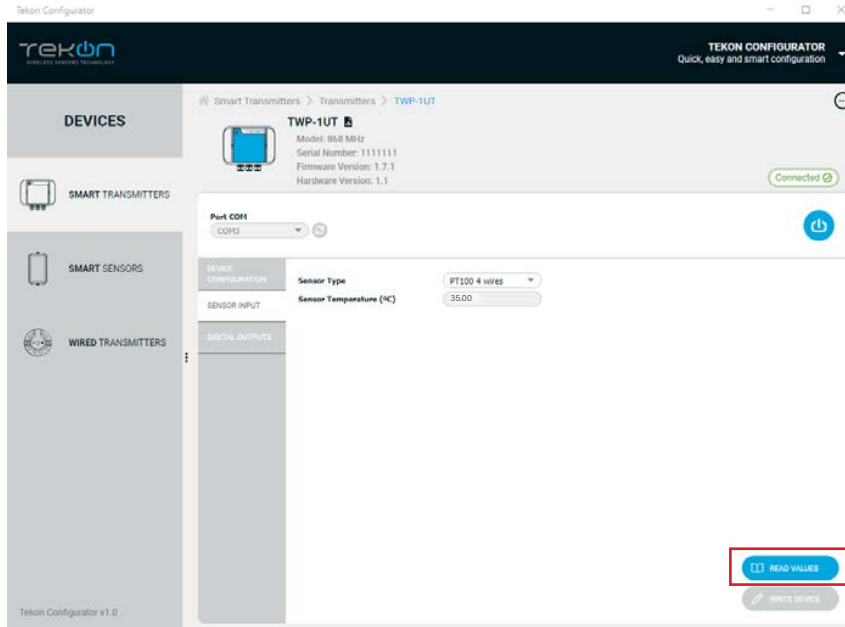Validate configuration by clicking on *Read Values* button.



After clicking the button, wait for the status  to change to . To confirm that the reading has taken place.

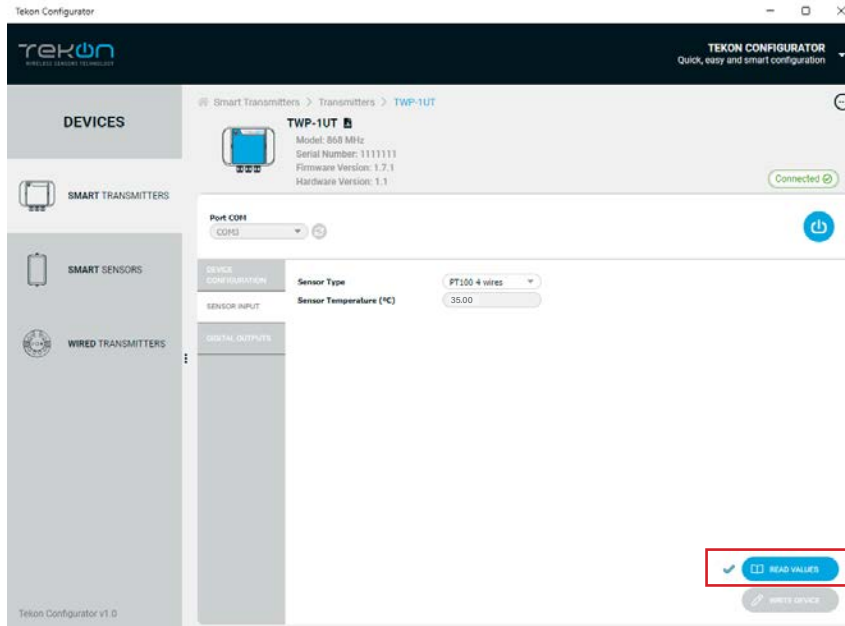

If the writing of the device is not completed, you will see . Make sure that all the steps have been carried out correctly.





**NOTE:**  
Configuration and Operation validated.

step  
**03** | TWP-XUT TRANSMITTER TEMPERATURE INPUT CONFIGURATION

07

Exit configuration mode and compare data sent by wireless communication.

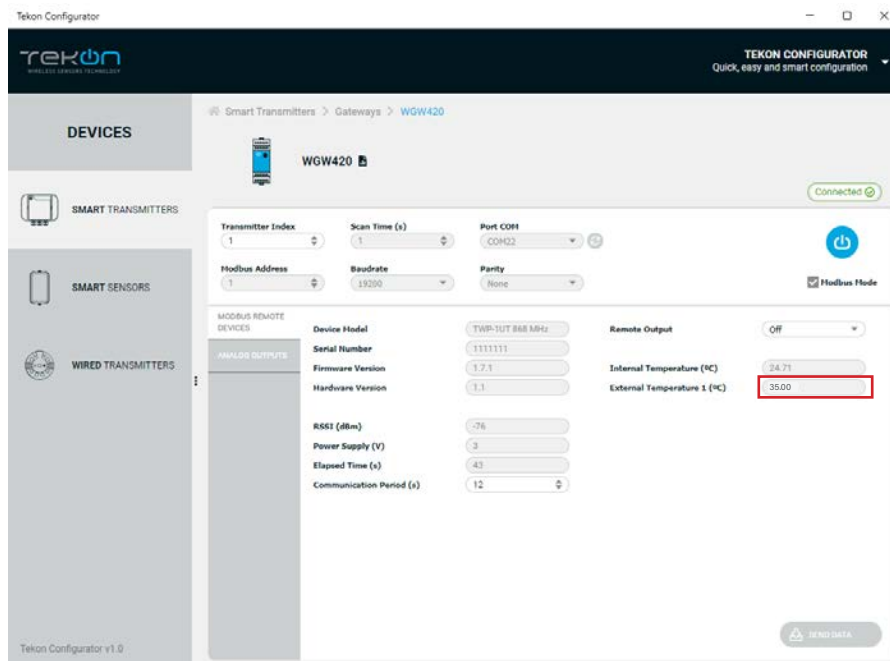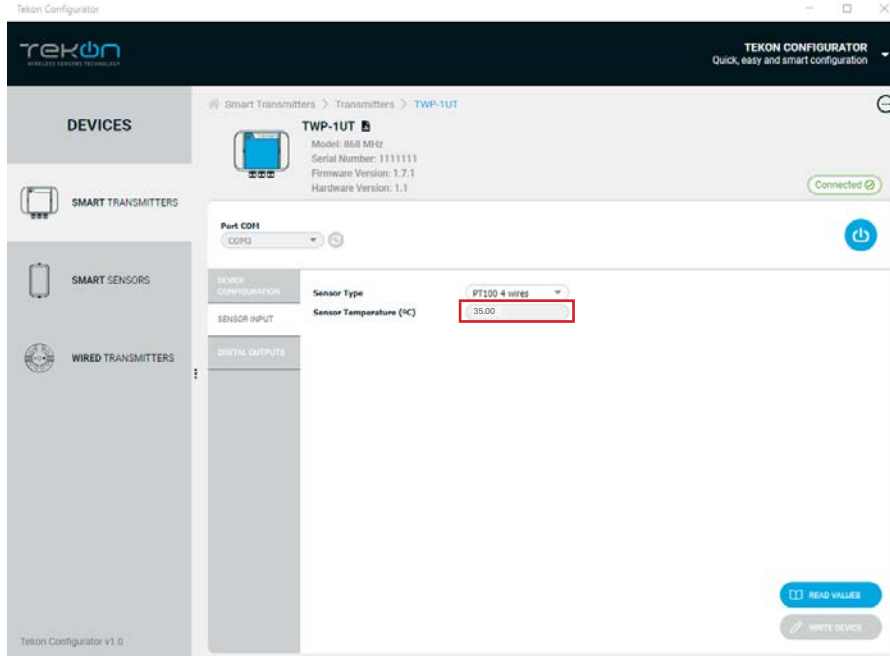

step  
**04**

**TWP-XUT TRANSMITTER DIGITAL OUTPUT CONFIGURATION**

step

# 04


## TWP-XUT TRANSMITTER DIGITAL OUTPUTS CONFIGURATION

**01**

To enter in *Configuration Mode* follow steps 01 to 07 of TWP-XUT PLUS Wireless *Transmitter* Configuration.

**02**

In *Tekon Configurator Software* select *Digital Outputs*.

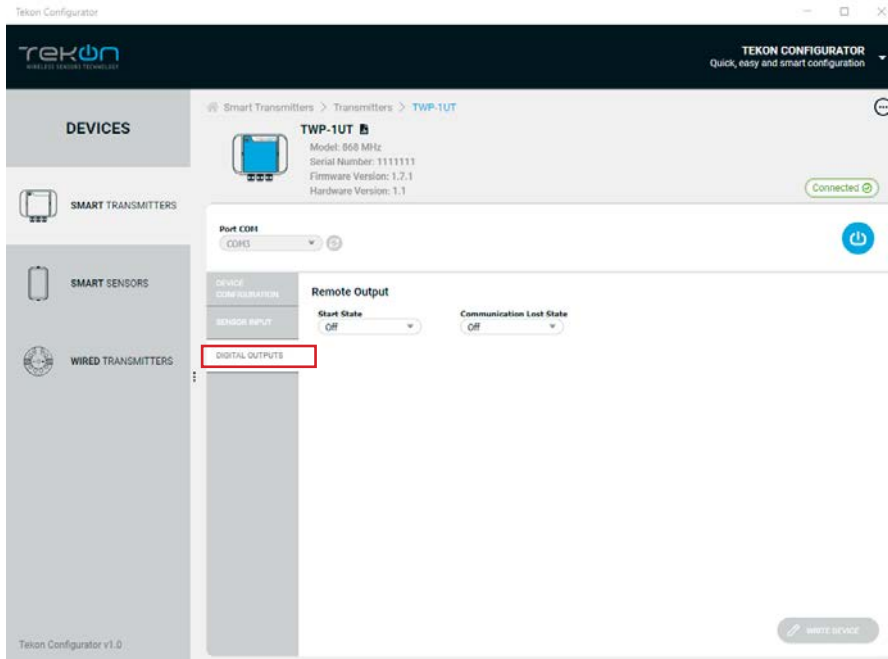




**03**


### Remote Control Output

Digital output remotely controlled by Gateway modbus protocol.

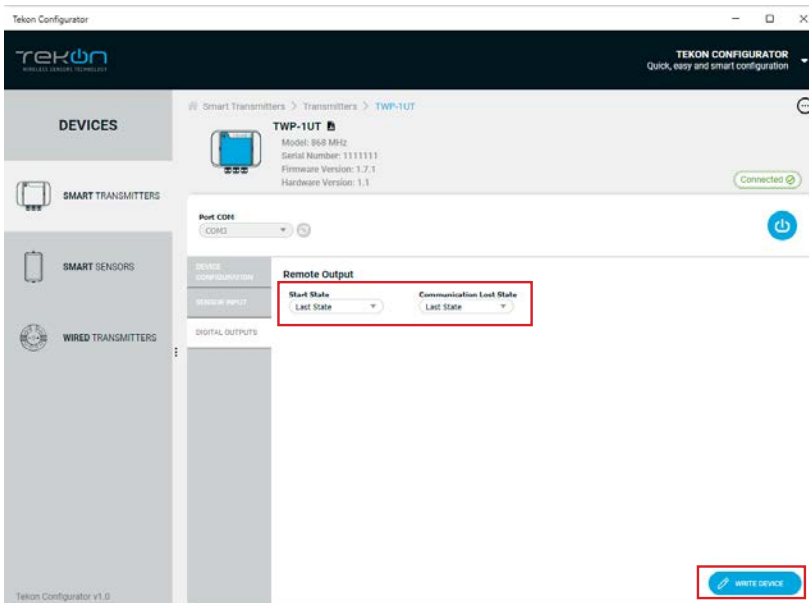Define *Start state* and *Communication lost state*. Click on *Write Device* button.




Wait for the software to write the new setting to the device. The status  of should change to .

If the writing of the device is not completed, you will see . Make sure that all the steps have been carried out correctly.

TWP-XUT TRANSMITTER DIGITAL OUTPUTS CONFIGURATION


**04**

Exit configuration mode and verify setup by checking LEDs indicators.

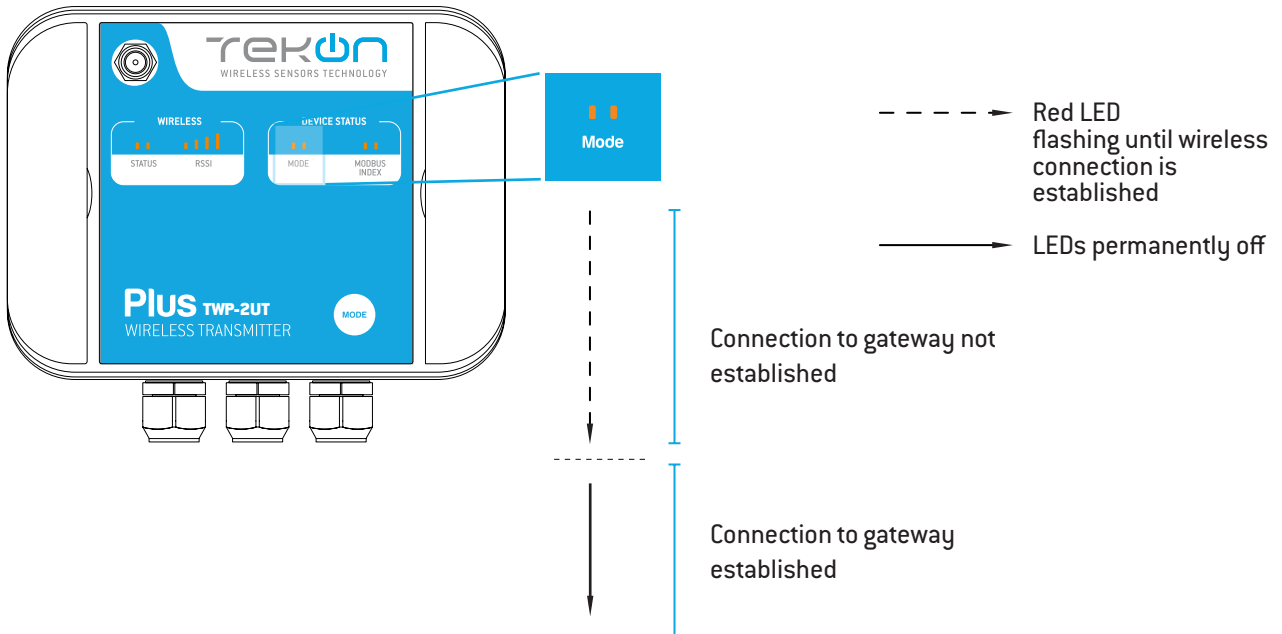

**03**

Using the Tekon Configurator you can change the State of Remote Output by setting the modbus register on the gateway. The gateway will send the information in the next time the transmitter performs a communication.

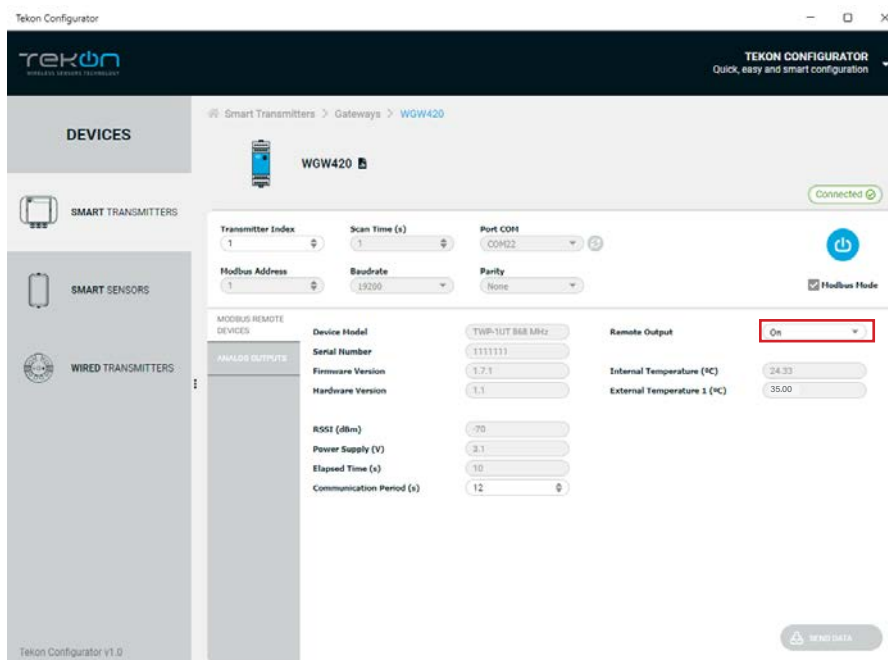


step  
**05**

**WGW420 GATEWAY ANALOG OUTPUTS CONFIGURATION**

**01** Follow steps 06 and 07 of the PLUS Wireless Gateway Configuration.

**02** In *Tekon Configurator Software* select **MODBUS MODE >> ANALOG OUTPUTS**

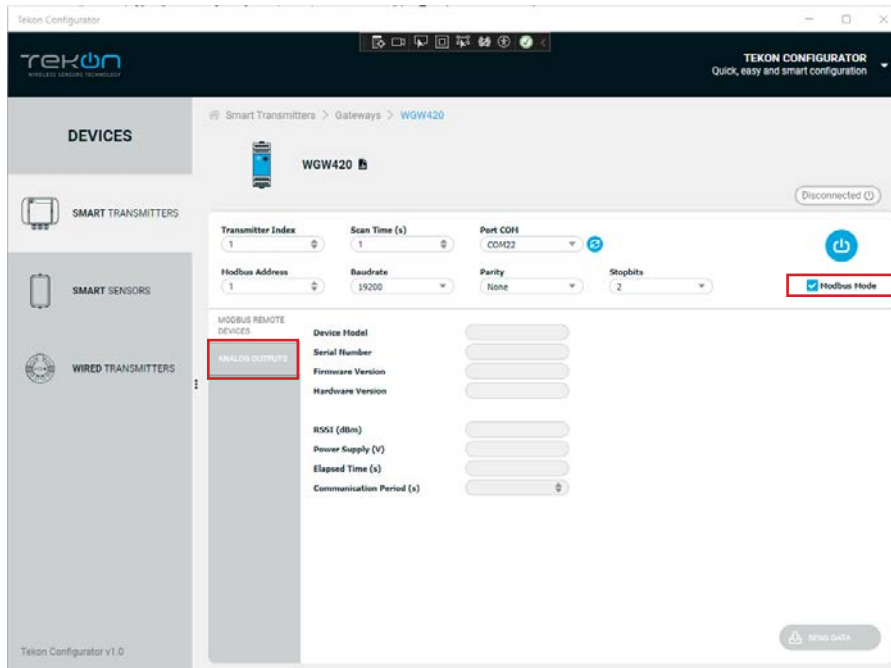

**03** Considering the transmitter configuration with Modbus Address=1, there is a Gateway Modbus Address Window corresponding to Modbus address window [0-19].

MB Add

HOLDING REGISTERS - TRANSMITTERS DATA		
Description	Address	
Serial Number	(Transmitter Modbus Index-1) x 20+0	0
Transmitter Model	(Transmitter Modbus Index-1)x20+2	
RSSI	(Transmitter Modbus Index-1)x20+3	
Communication Period	(Transmitter Modbus Index-1)x20+4	
Elapsed Time	(Transmitter Modbus Index-1)x20+5	
Power Voltage	(Transmitter Modbus Index-1)x20+6	
Data 0	(Transmitter Modbus Index-1)x20+7	
Data 1	(Transmitter Modbus Index-1)x20+9	9
Data 2	(Transmitter Modbus Index-1)x20+11	
Data 3	(Transmitter Modbus Index-1)x20+13	
Data 4	(Transmitter Modbus Index-1)x20+15	
FW Version Major Minor	(Transmitter Modbus Index-1)x20+17	
FW Version Revision	(Transmitter Modbus Index-1)x20+18	
HW Version Major Minor	(Transmitter Modbus Index-1)x20+19	19



**NOTE:**

Transmitter analog input 1 data is received and stored at the Gateway Modbus address [9].


step

# 05

## GATEWAY ANALOG OUTPUTS

04


Link *Analog Output Index 1* (Gateway) to *Analog Input 1* (Transmitter) and configure MB Add Link according to the previous step. Set minimum and maximum values and click on *Write*

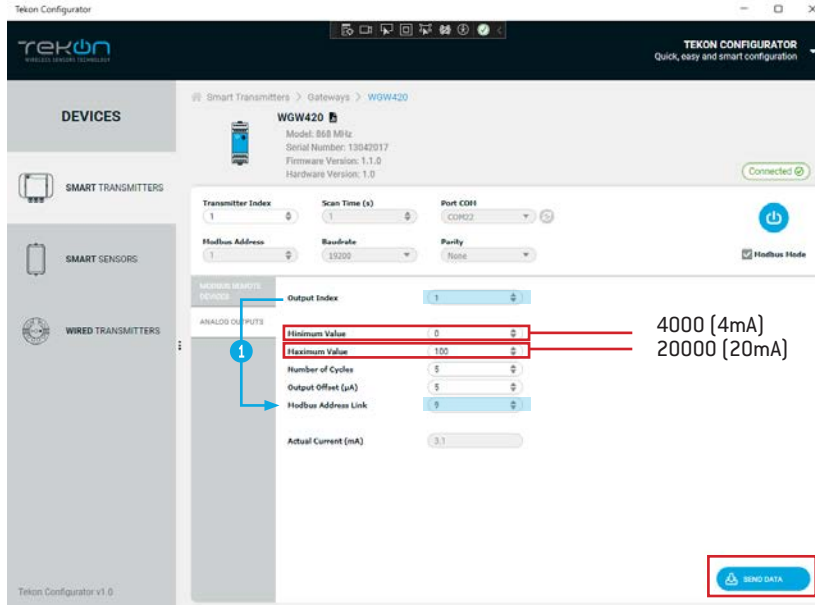

**NOTE:**

① Output index 1 is linked to modbus address [9], according to mapping table of step 03.

Modbus address double word (float 32) value is converted into 4..20 mA scale according to minimum and maximum defined values.

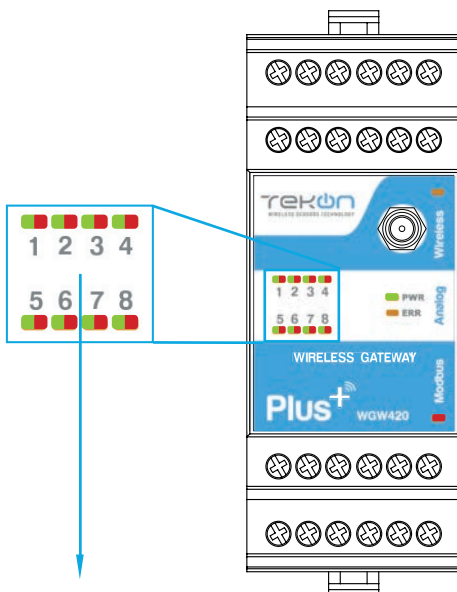

1

Green led permanently on during a closed current loop

2

Red led permanently on during an open current loop



step  
**06**

**WRP001 PLUS WIRELESS REPEATER CONFIGURATION**

step  
**06**

CONNECT AND CONFIGURE THE PLUS WIRELESS REPEATER


**01**

Loosen the 4 screws of the case and open it.



**02**


Connect a micro USB cable to the computer and then to *WRP001 PLUS Wireless Repeater*.

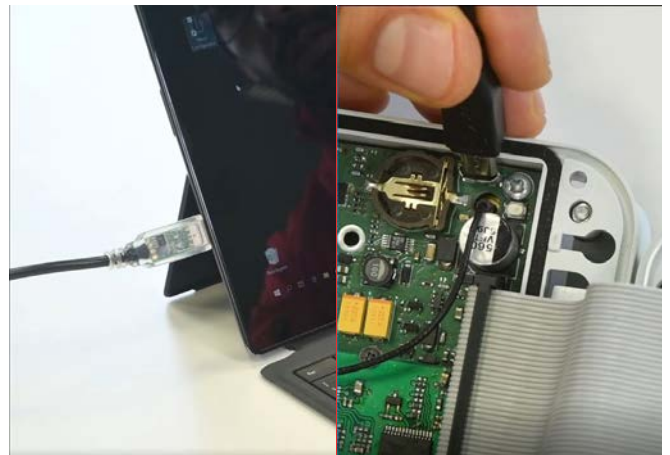

**03**


Open the WRP001 PLUS Wireless Repeater device page. There are two different ways to get to the device page.

**1st option:** Click on “**SMART TRANSMITTERS**” in the left menu and then click on the device.

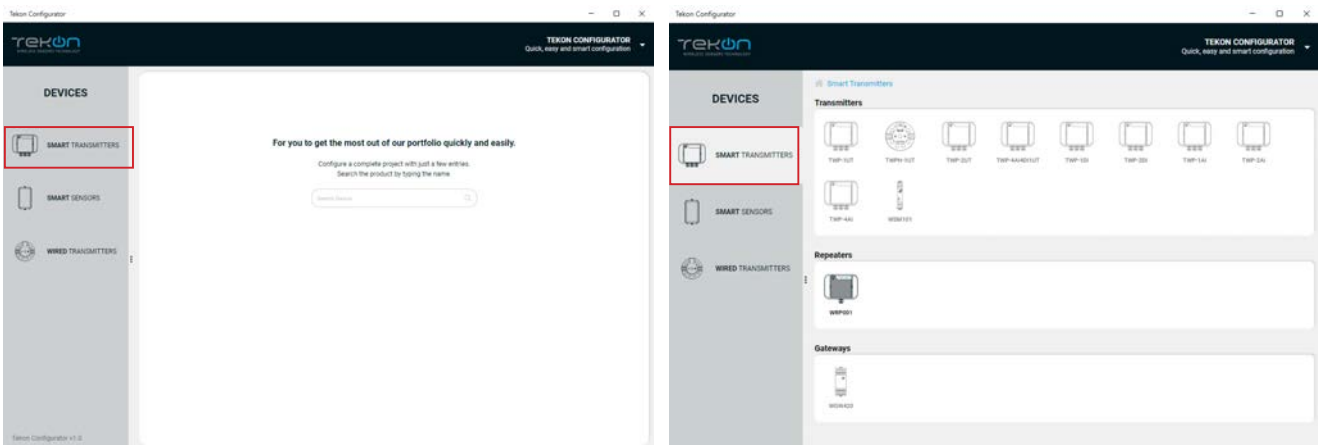


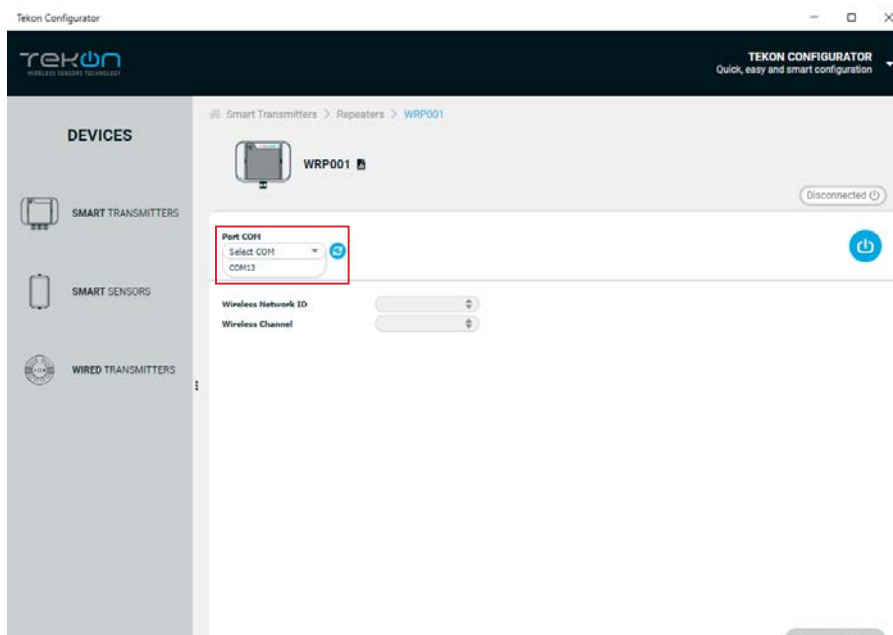
CONNECT AND CONFIGURE THE PLUS WIRELESS REPEATER

**2nd option:** Enter the name of the device in the “Search Device” field on the home page and select.

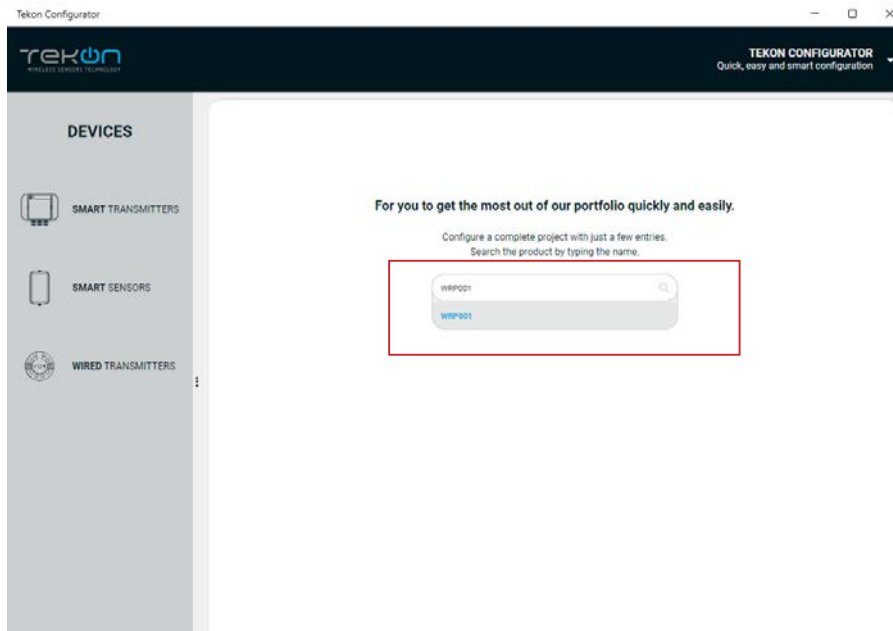

**04**

Load the “Port COM” corresponding to the WRP001 PLUS Wireless Repeater.  
If the USB cable has already been connected before opening the device’s page, the “COM Port” will appear in the list, otherwise click on the button .




step  
**06**

CONNECT AND CONFIGURE THE PLUS WIRELESS REPEATER


**05**

Select *Port Com*<sup>1</sup>.

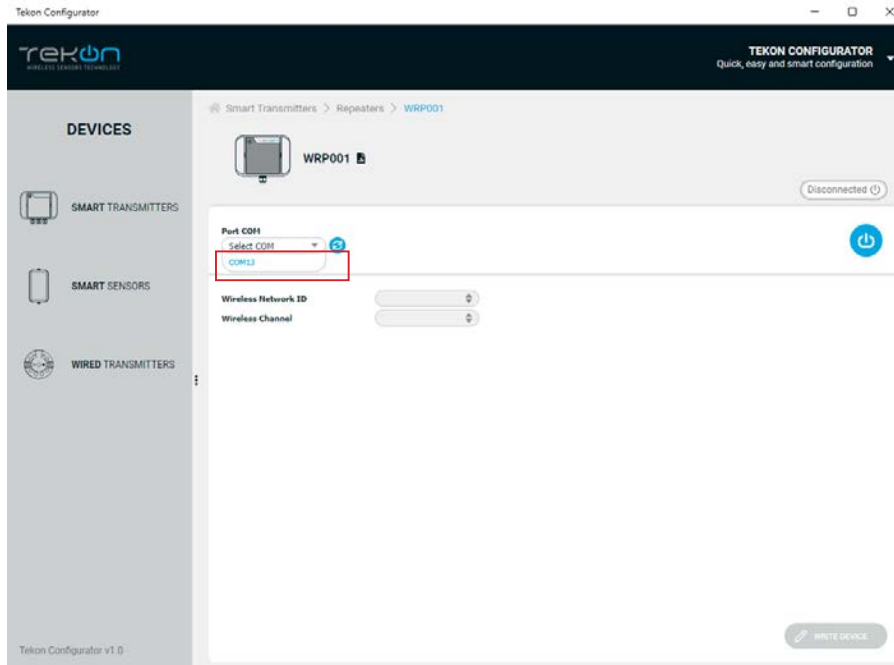


**06**

Click on *Configuration Mode* (⏻) button.

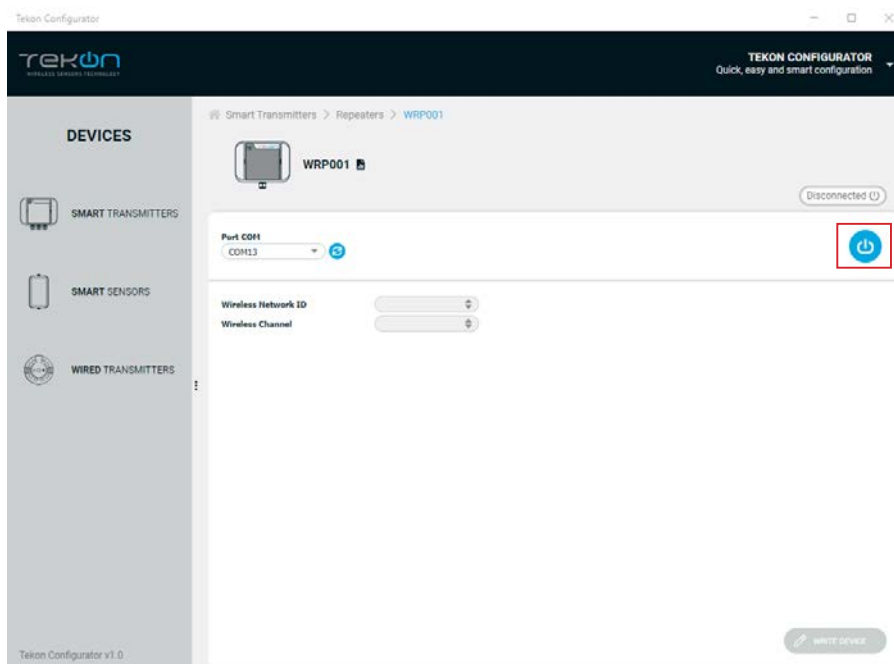


<sup>1</sup> You can check device's serial port name in "Device Manager" on Microsoft® Windows® operating system.


CONNECT AND CONFIGURE THE PLUS WIRELESS REPEATER

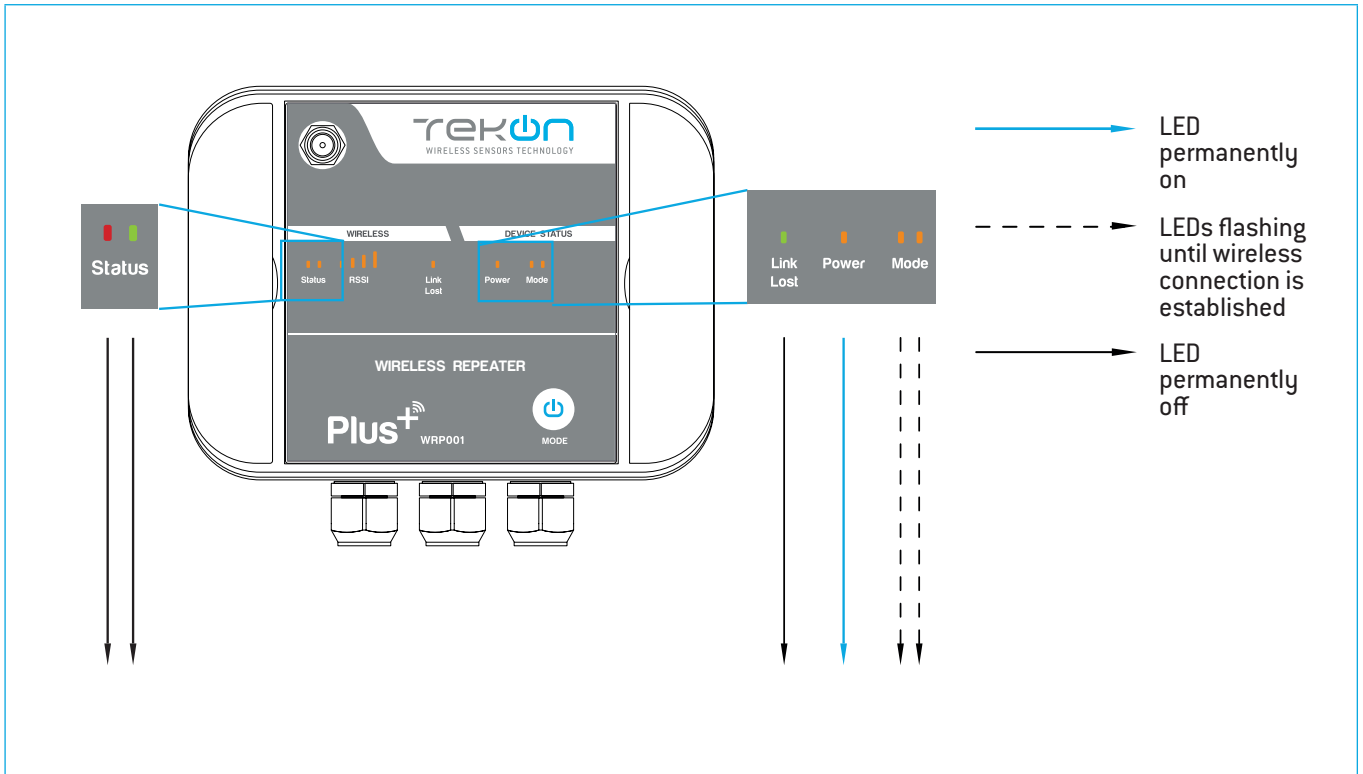

**07**

The software will connect to the device.

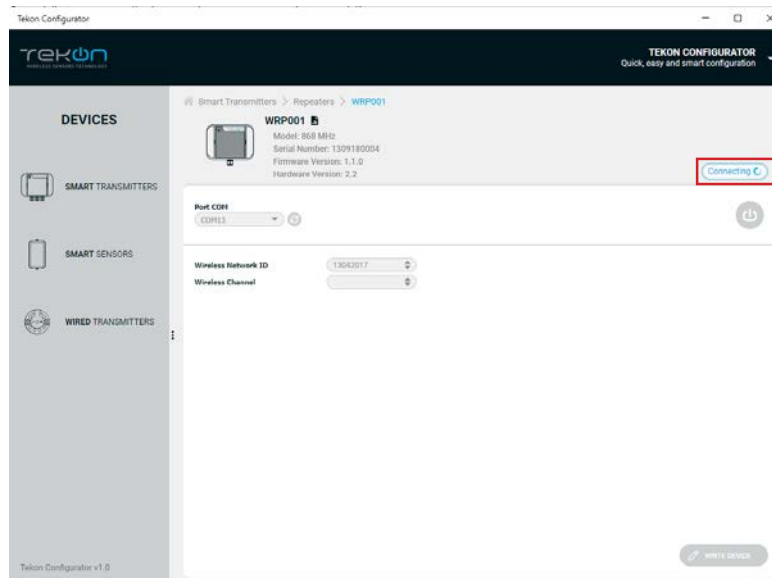


**NOTE:** If the software is unable to connect to the device, the  Unexpected Error status is displayed. If it hasn't connected, go back to the previous steps and check the port COM.

step  
**06**

CONNECT AND CONFIGURE THE PLUS WIRELESS REPEATER


**08**

When the software connects to the device, the “*Connected*” message will be displayed.

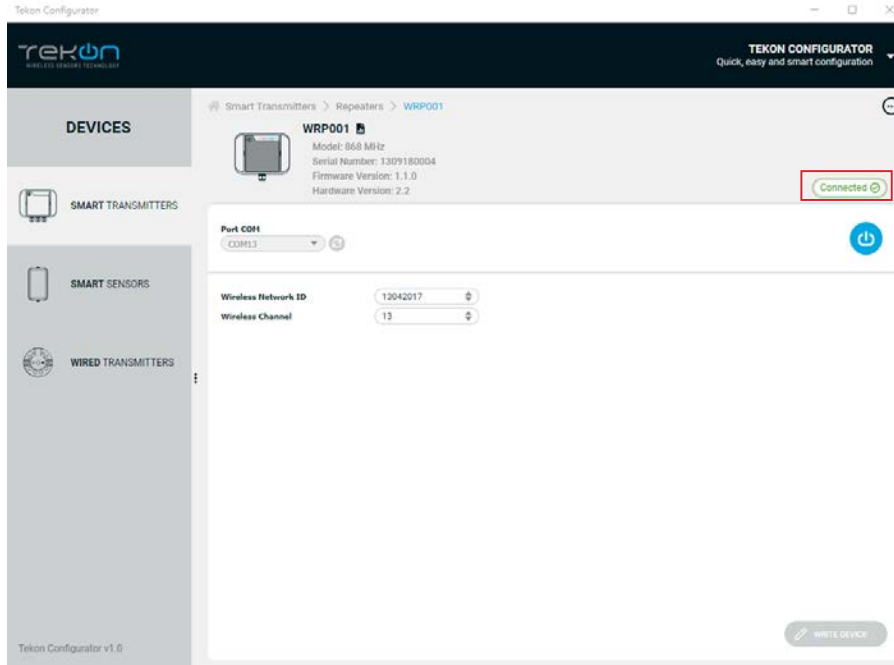



**09**

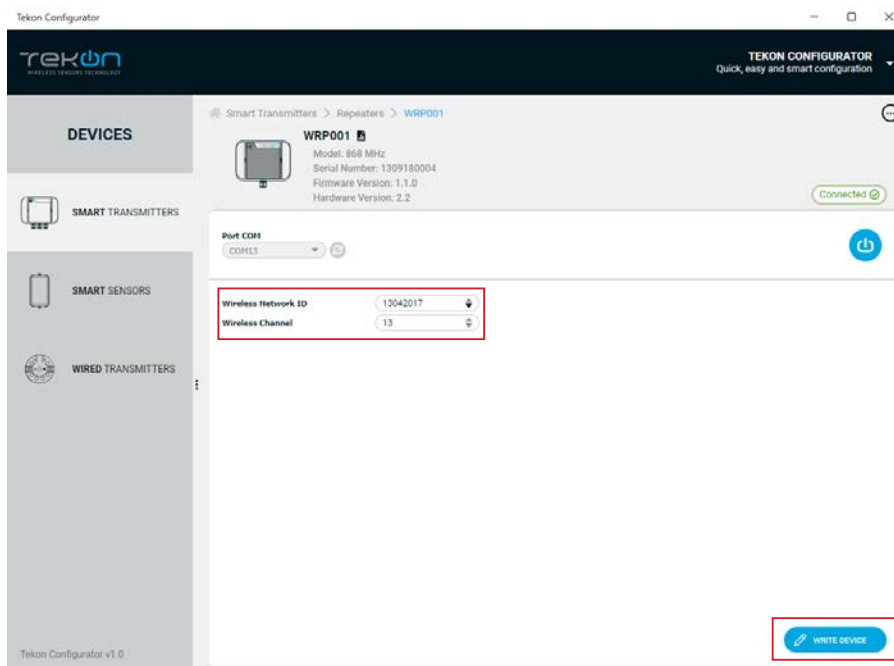
Configure the “*Wireless Network ID*” and “*Wireless Channel*” previously obtained from the Gateway. Click on the “*WRITE DEVICE*” button to update the transmitter settings.




CONNECT AND CONFIGURE THE PLUS WIRELESS REPEATER


10


Wait for the software to write the new setting to the device. Wait for the status  to change to .

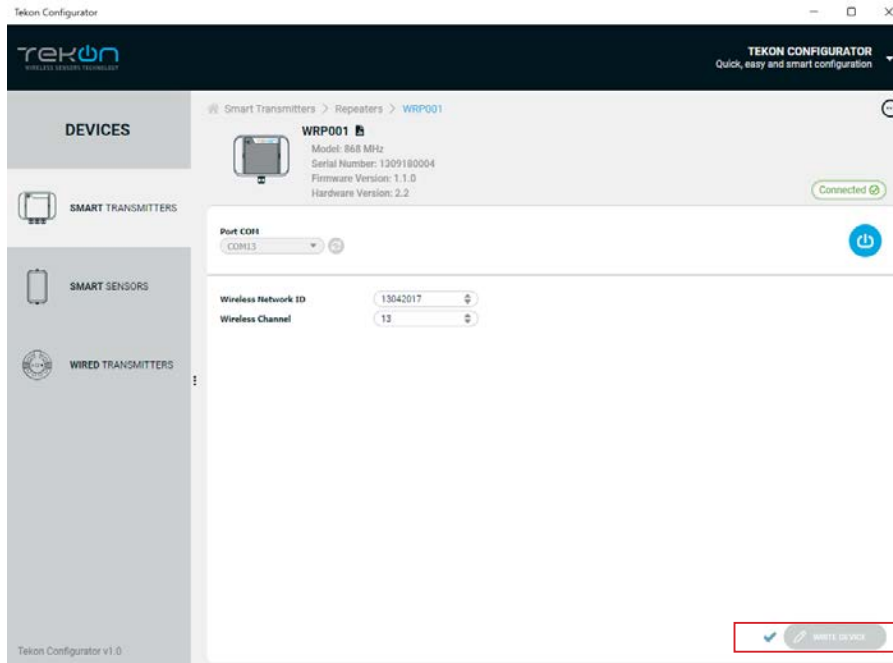

If the writing of the device is not completed, you will see . Make sure that all the steps have been carried out correctly.


11

Click  to exit the configuration and return to normal operating mode.

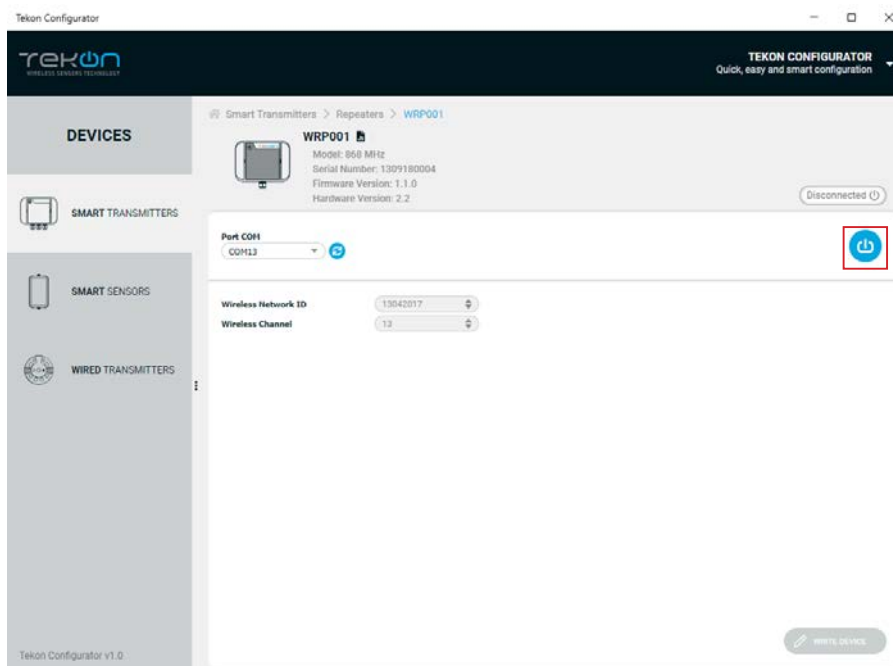

step  
**06**

CONNECT AND CONFIGURE THE PLUS WIRELESS REPEATER

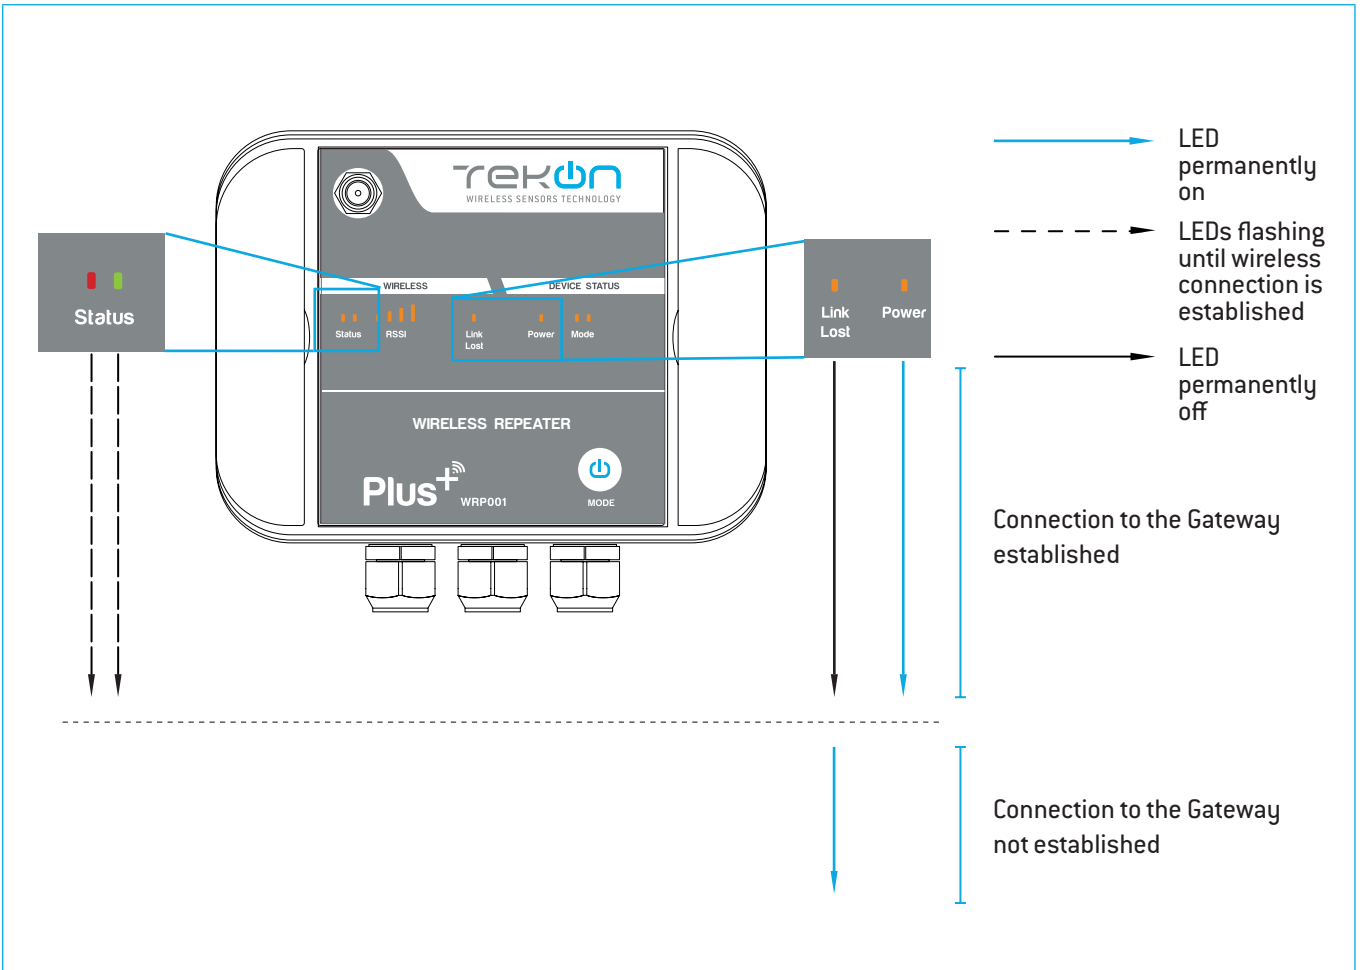



step  
**07**  
SITE SURVEY MODE

step  
**07** | SITE SURVEY MODE


Site survey mode is a tool that allows a quick wireless signal strength evaluation at the site of installation. It doesn't require additional equipment or software.

This feature is available in all the transmitters and repeater from PLUS Product Family.

**01**

Press and hold Mode (  ) button until Status LEDs are permanently on and Mode LEDs flash.

RSSI LEDs indicate the signal strength.

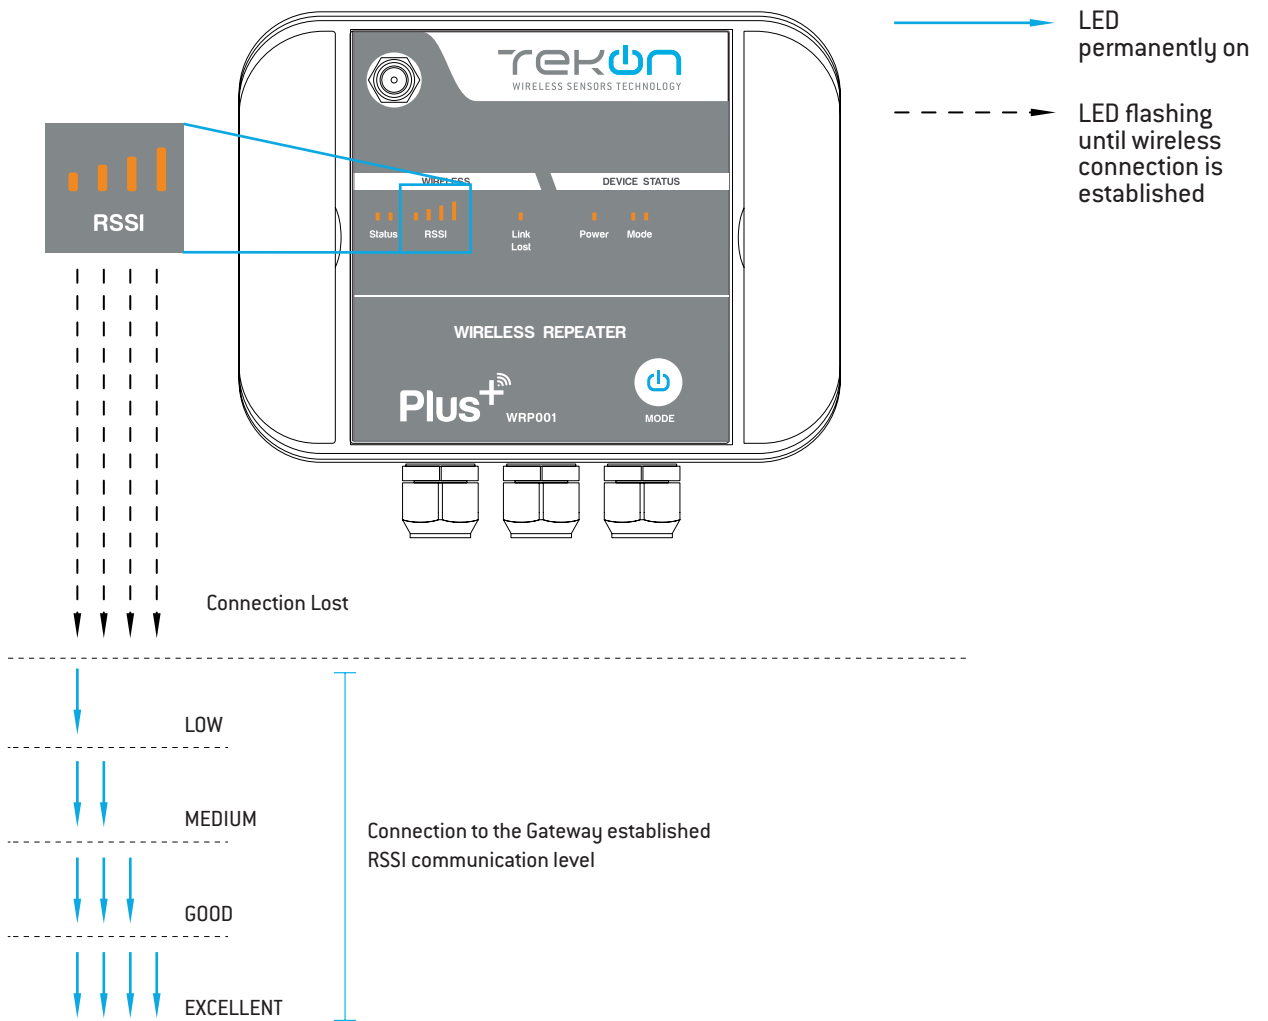

**02**

Press and hold Mode (  ) button until RSSI LEDs switch off and device resumes normal operation mode.



## **TEKON ELECTRONICS**

a brand of Bresimar Automação S.A.

Avenida Europa, 460  
Quinta do Simão  
3800-230 Aveiro  
PORTUGAL

### **Sales**

P.: +351 234 303 320  
M.: +351 933 033 250  
E.: [sales@tekonelectronics.com](mailto:sales@tekonelectronics.com)

### **Technical Support**

E.: [support@tekonelectronics.com](mailto:support@tekonelectronics.com)

